


0 5 Centimetres 10 15 20 25 30

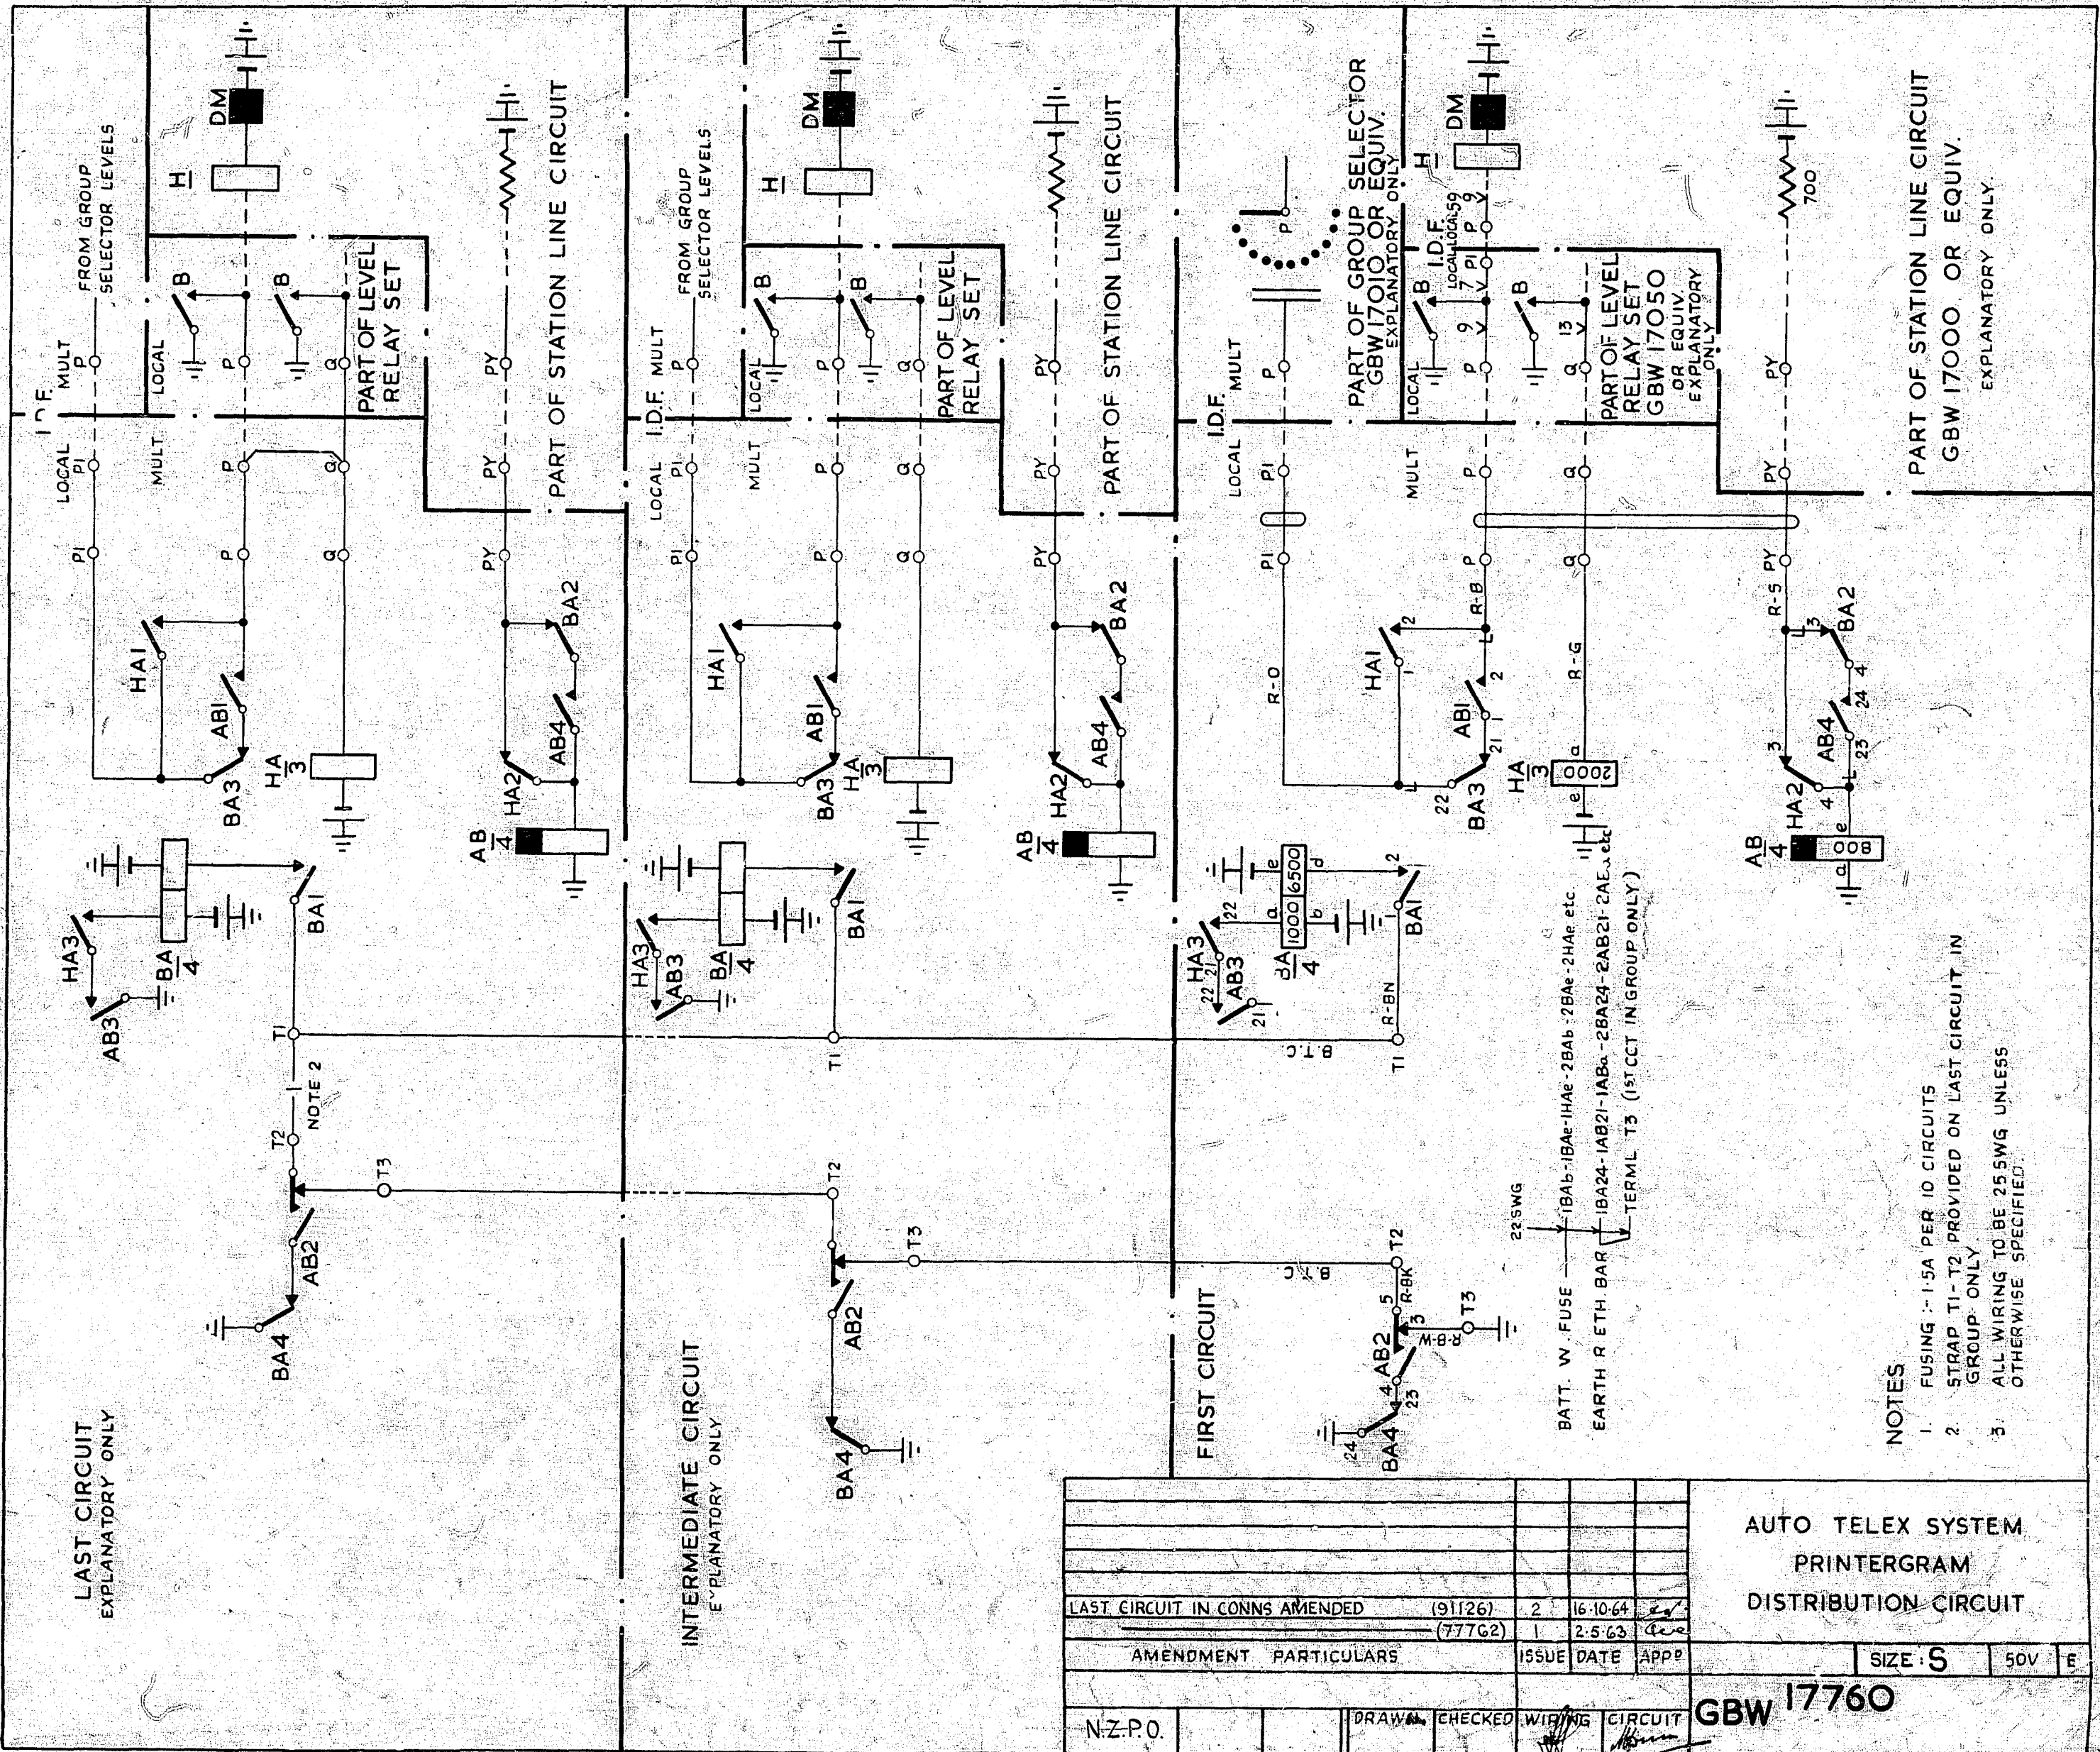

NOTES

1. FUSING 1.5A PER ID CIRCUITS
2. STRAP T1-T2 PROVIDED ON LAST CIRCUIT IN GROUP ONLY
3. ALL WIRING TO BE 25.5SWG UNLESS OTHERWISE SPECIFIED.

				AUTO TELEX SYSTEM PRINTERGRAM DISTRIBUTION CIRCUIT		
LAST CIRCUIT IN CONNS AMENDED		(91126)	2	16-10-64		
		(777G2)	1	2-5-63		
AMENDMENT PARTICULARS		ISSUE	DATE	APPD	SIZE S	50V E
N.Z.P.O.	DRAWN	CHECKED	WIRING	CIRCUIT	GBW 17760	