


FIG. 1. TEST TRUNK TO E.C.B.

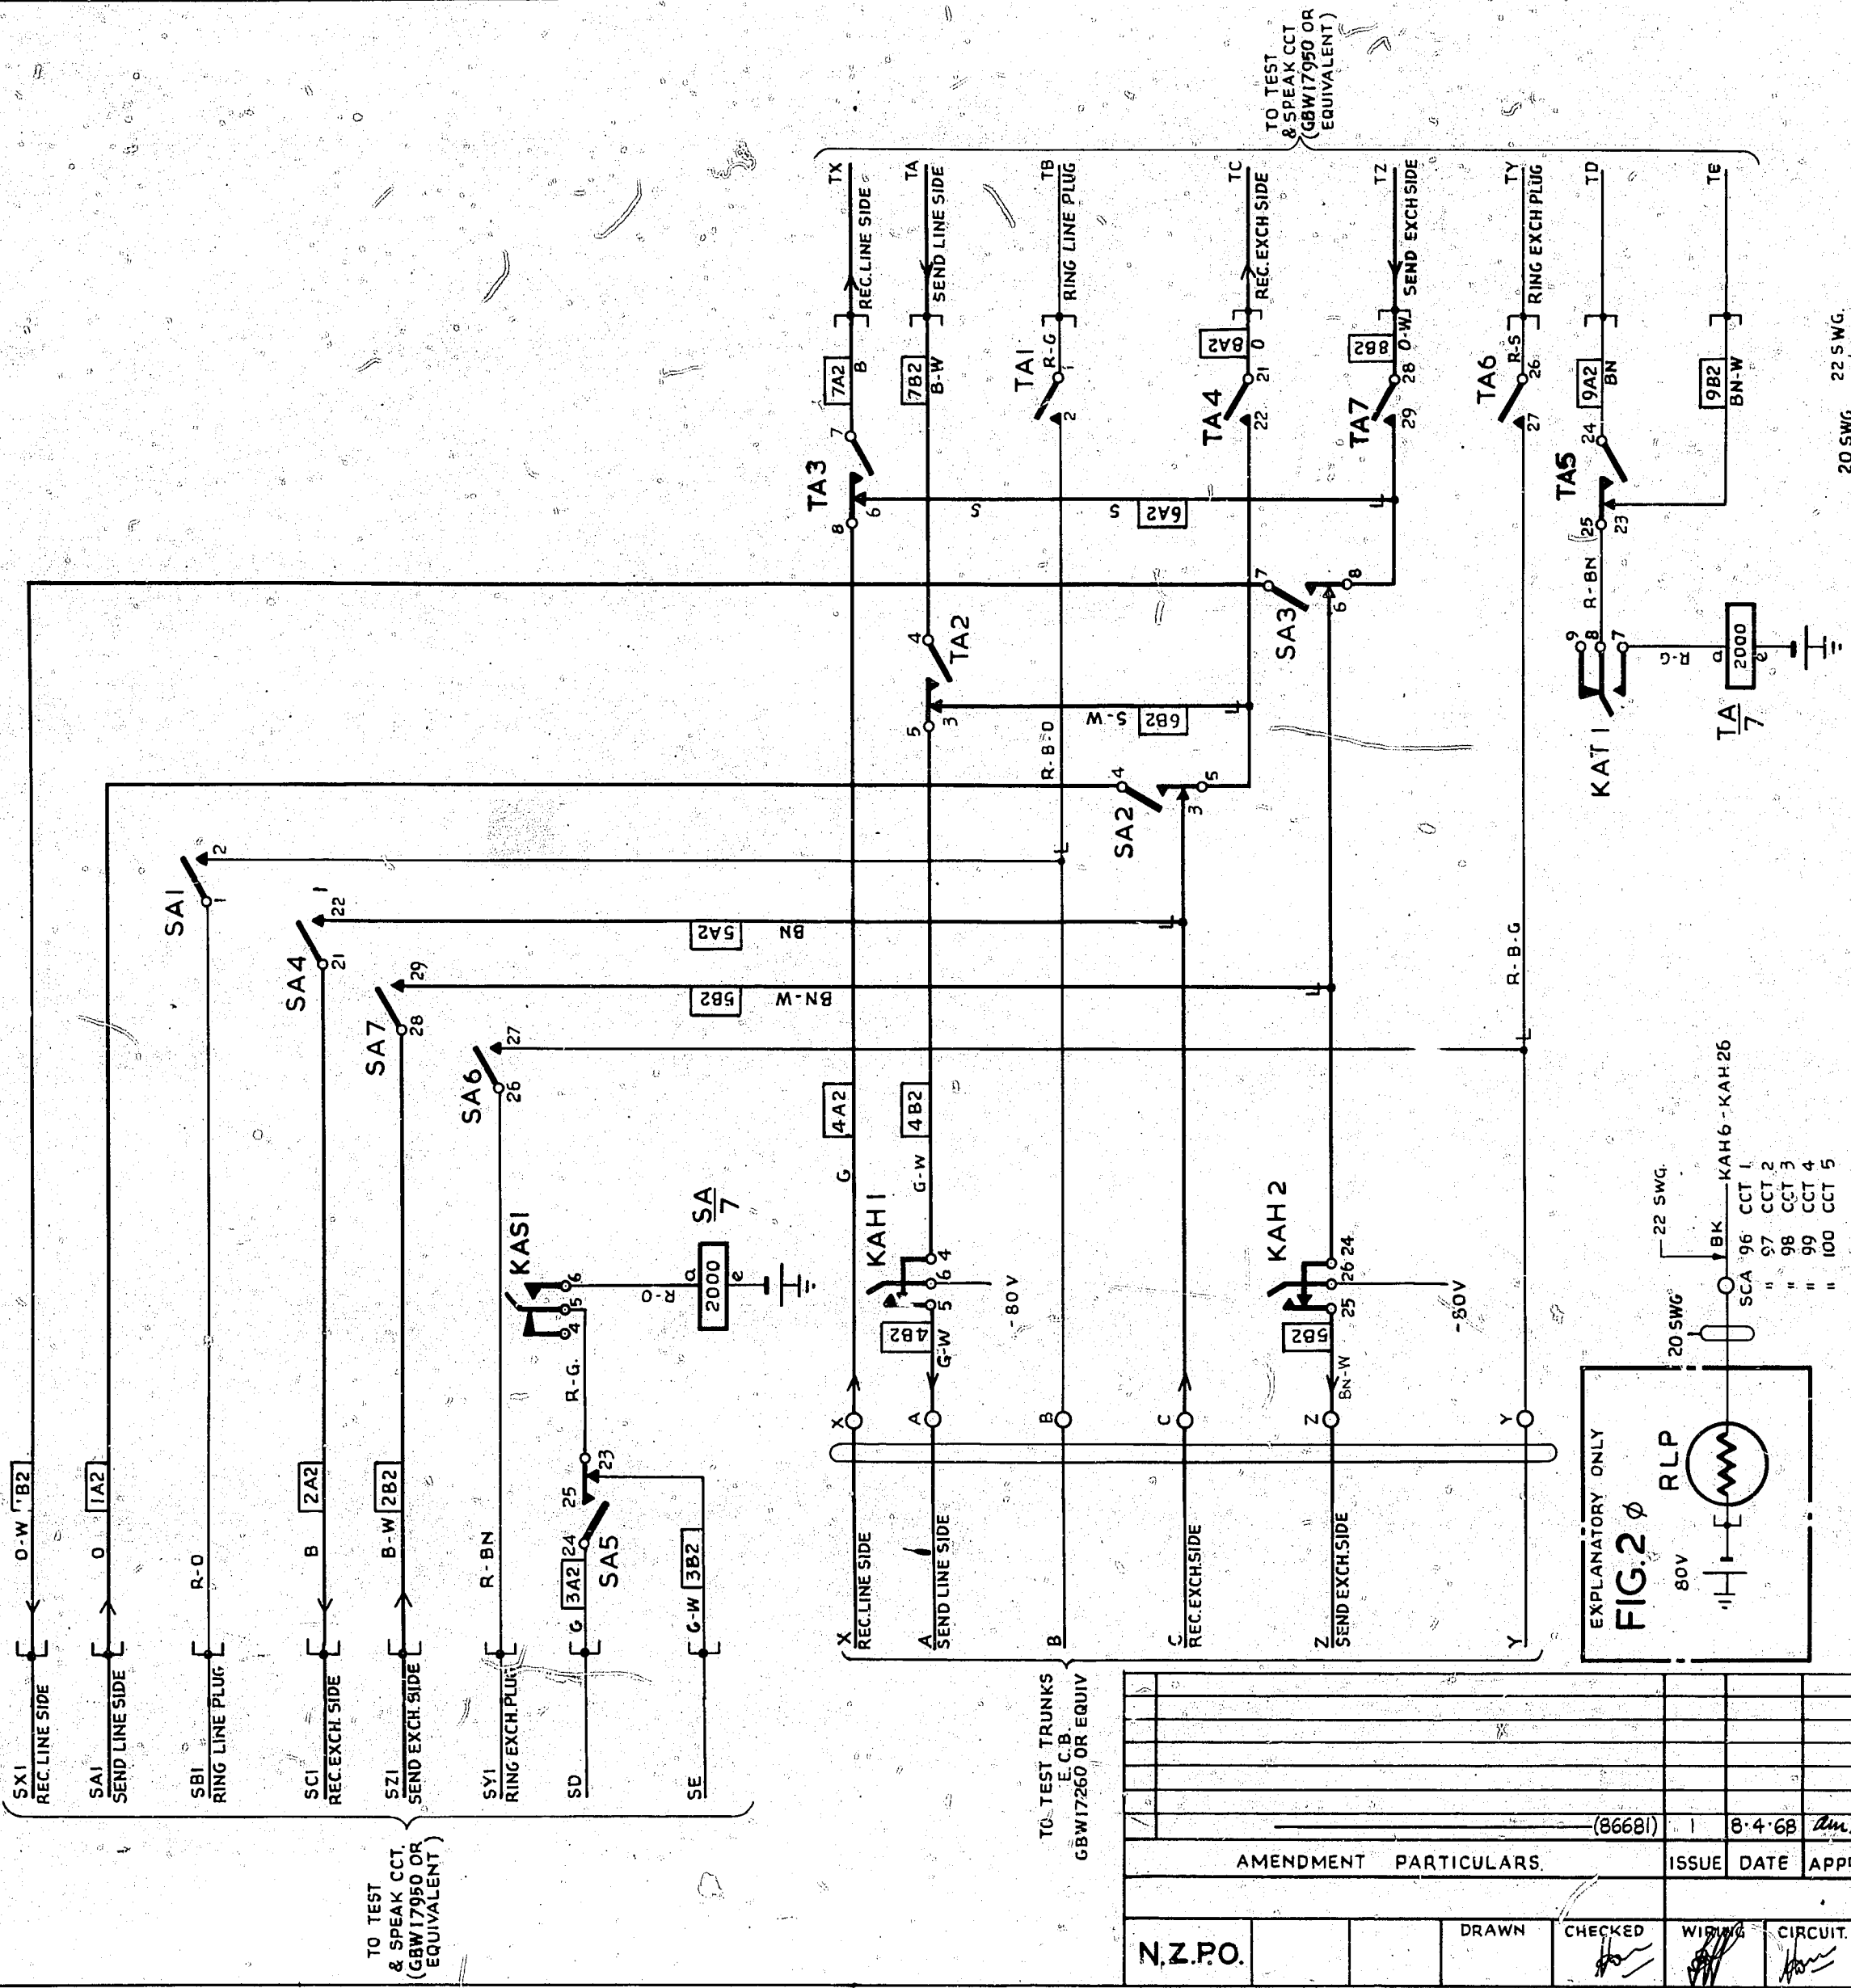

- NOTES
- 1 FUSING: -50V = 1.0A PER THREE CCTS. PER TEST POSITION. FUSED ON M.A.R.
 - 2 ALL WIRING TO BE 25 SWG. UNLESS OTHERWISE SPECIFIED.
 - 3 THE DIRECTION OF TRANSMISSION IS SHOWN THUS \rightarrow
 - 4 ϕ FOR WIRING SEE GBW 17380 OR EQUIVALENT.

AUTOMATIC TELEX SYSTEM			
TEST TRUNK TO ENGINEERING CONTROL BOARD			
TERMINATED ON THE TEST DESK			
AMENDMENT PARTICULARS.		ISSUE DATE	APPR.
		8.4.68	Am.
N.Z.P.O.		DRAWN	CHECKED
		WIRING	CIRCUIT.
		GBW 17920	
SPEAK(KAS) TEST (KAT)		HOLD(KAH)	
2		2	

SIZE: 5 50V: 6