
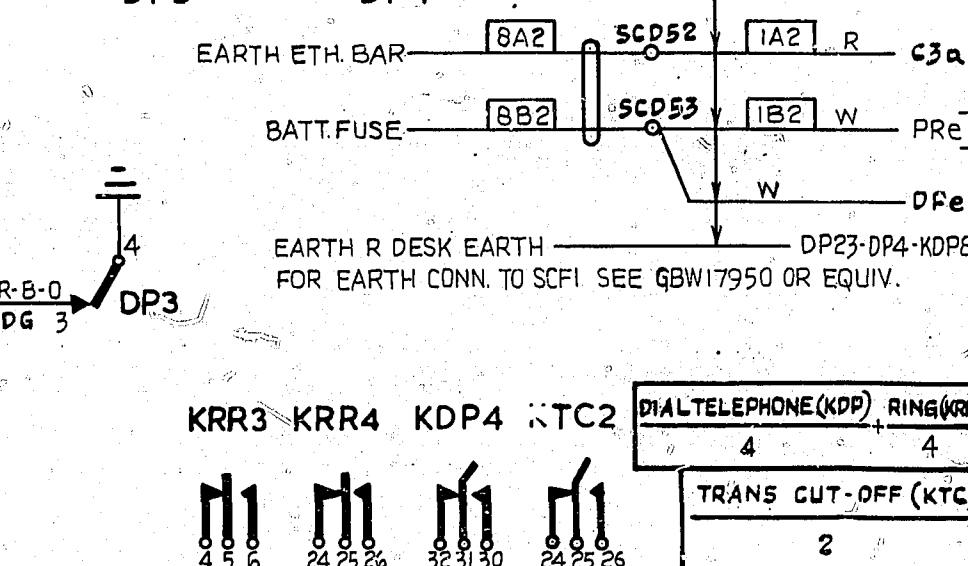
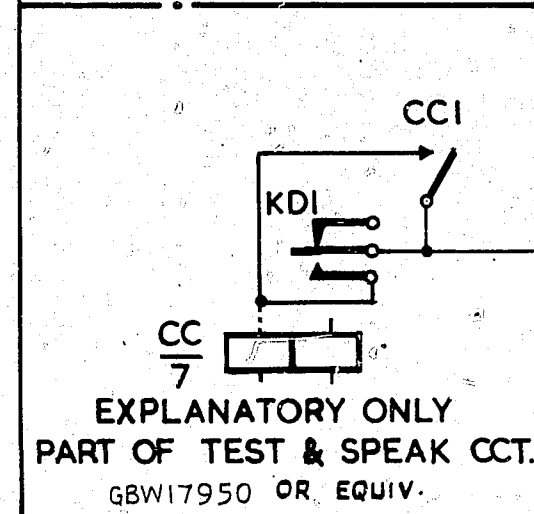
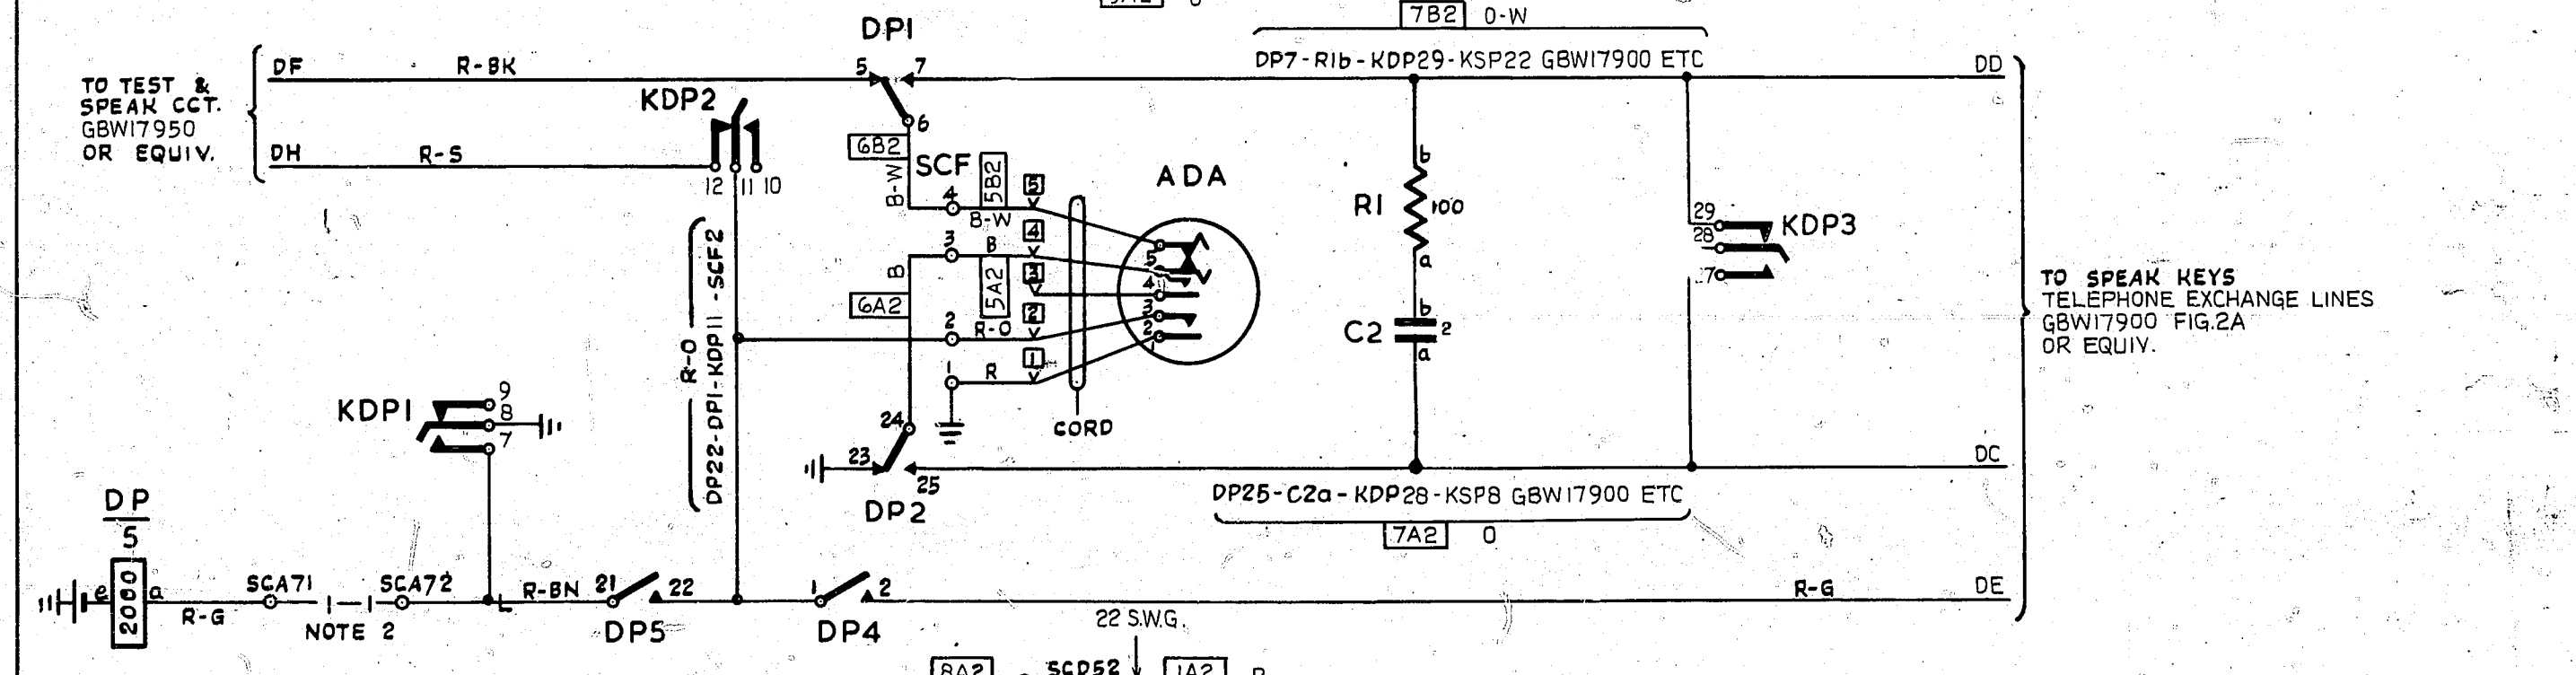


NOTES:-

1. -50V FUSED ON MAR. WITH TEST & SPEAK CCT. GBWI7950 OR EQUIV.
2. INSERT STRAP —I— WHEN EXCHANGE LINES ARE CONNECTED TO AUTO.
3. WIRING NOT OTHERWISE SPECIFIED TO BE 25 S.W.G.

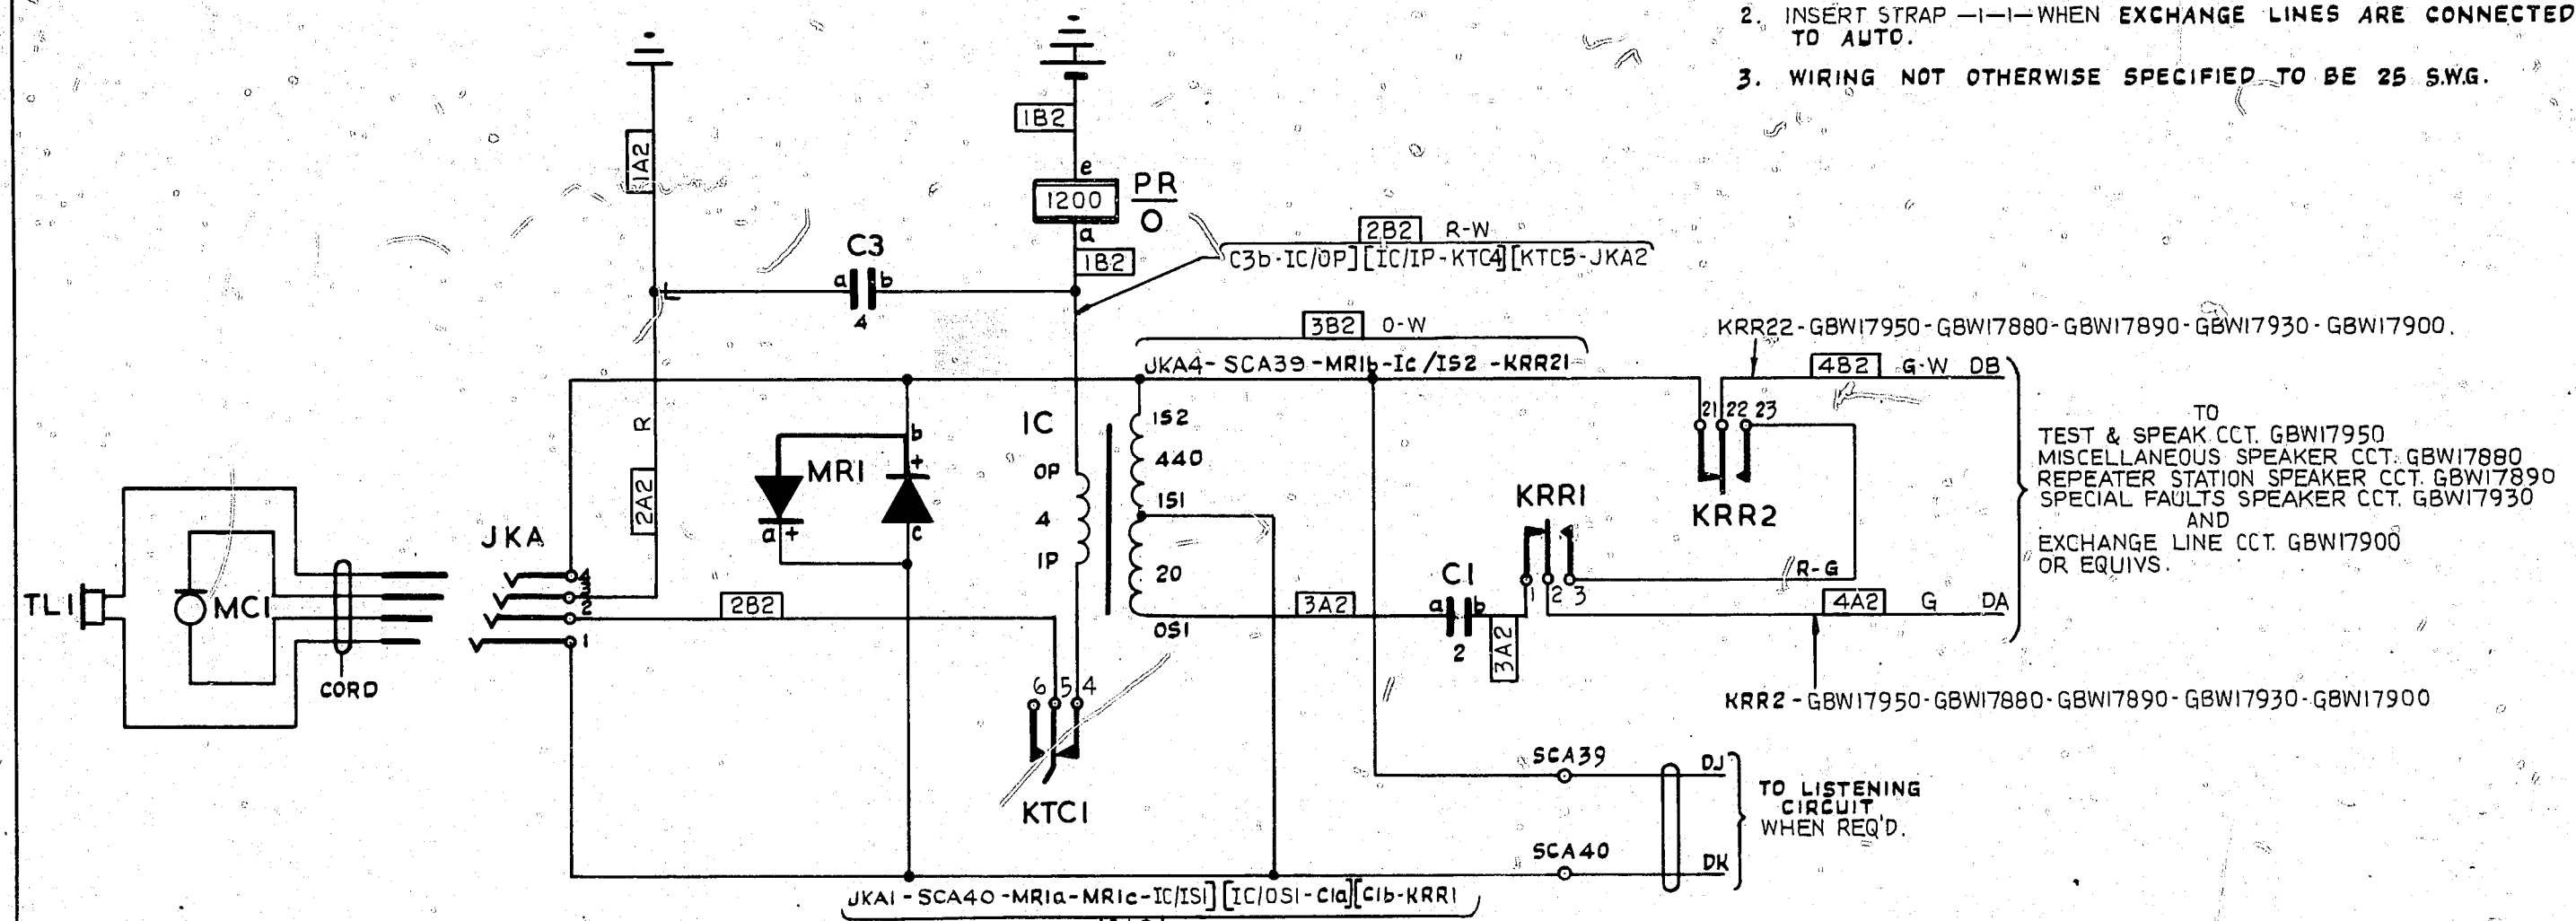

AUTOMATIC TELEX SYSTEM			
TEST DESK			
POSITION TELEPHONE CIRCUIT			
MINOR WIRING CORRECTION	(9834)	2	12.7.68 J.W.E.
	(86681)	1	8.4.68 <i>lan</i>
AMENDMENT PARTICULARS	ISSUE DATE	APP'D	SIZE: S 50V E
NZ.P.O.		DRAWN	CHECKED
		WIRING	CIRCUIT
GBWI7960			