


0
5 Centimetres
10
15
20

N.Z.P.O.	DRAWING CHECKED		WIRING CIRCUIT	
	AMENDMENT	PARAGRAPHS	ISSUE	DATE
		(58280)	1	10.2.67
				2/8
GBW 19130		REF: GBW11010	TEST RACK NIGHT ALARM CIRCUIT (GEO-THERMAL AREAS)	
		SIZE: F		
		E		

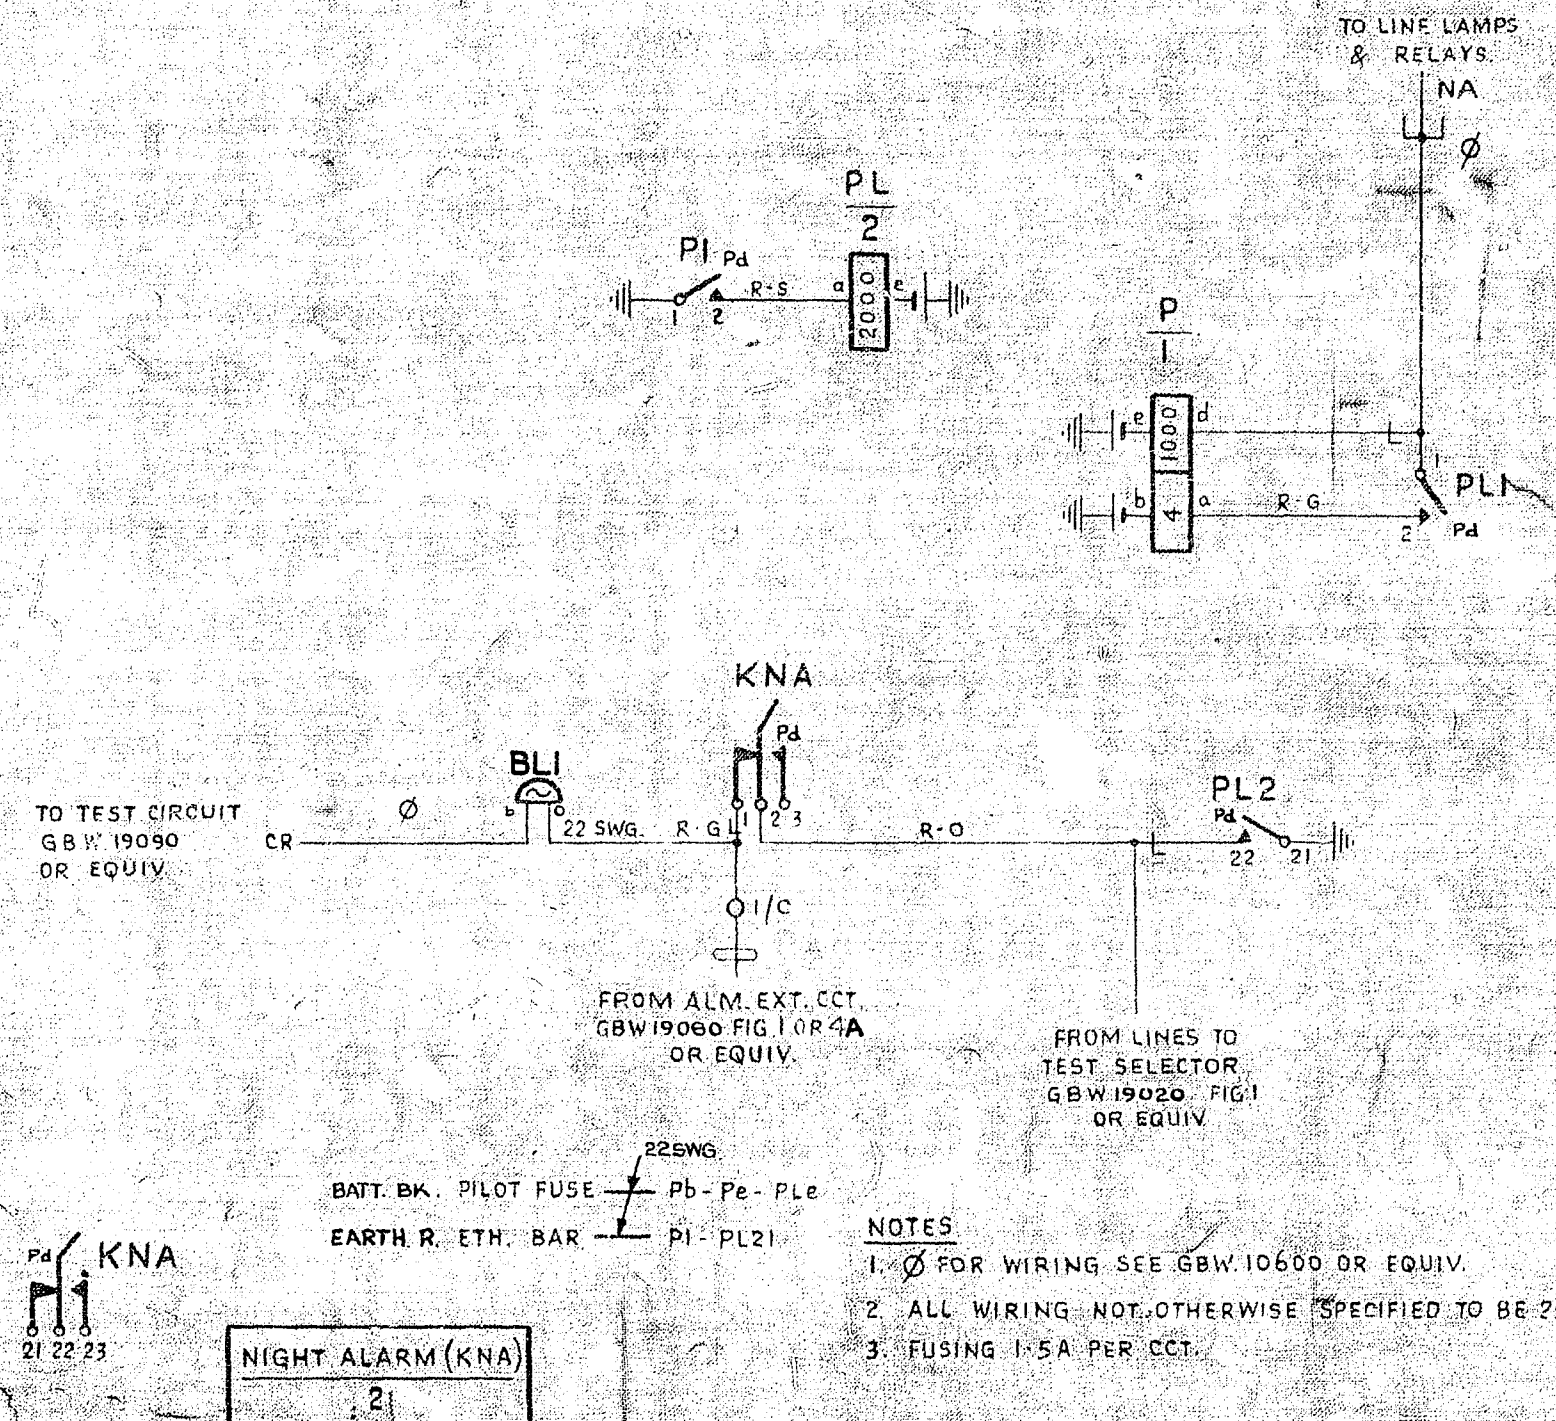

- NOTES**
1. Ø FOR WIRING SEE GBW.10600 OR EQUIV.
 2. ALL WIRING NOT OTHERWISE SPECIFIED TO BE 25SWG.
 3. FUSING 1.5A PER CCT.