


FIG. 2.

FIG. 1.

CTS  
EMERGENCY INTERCEPT KEYS

MANUAL BOARD  
(EXPLANATORY ONLY)

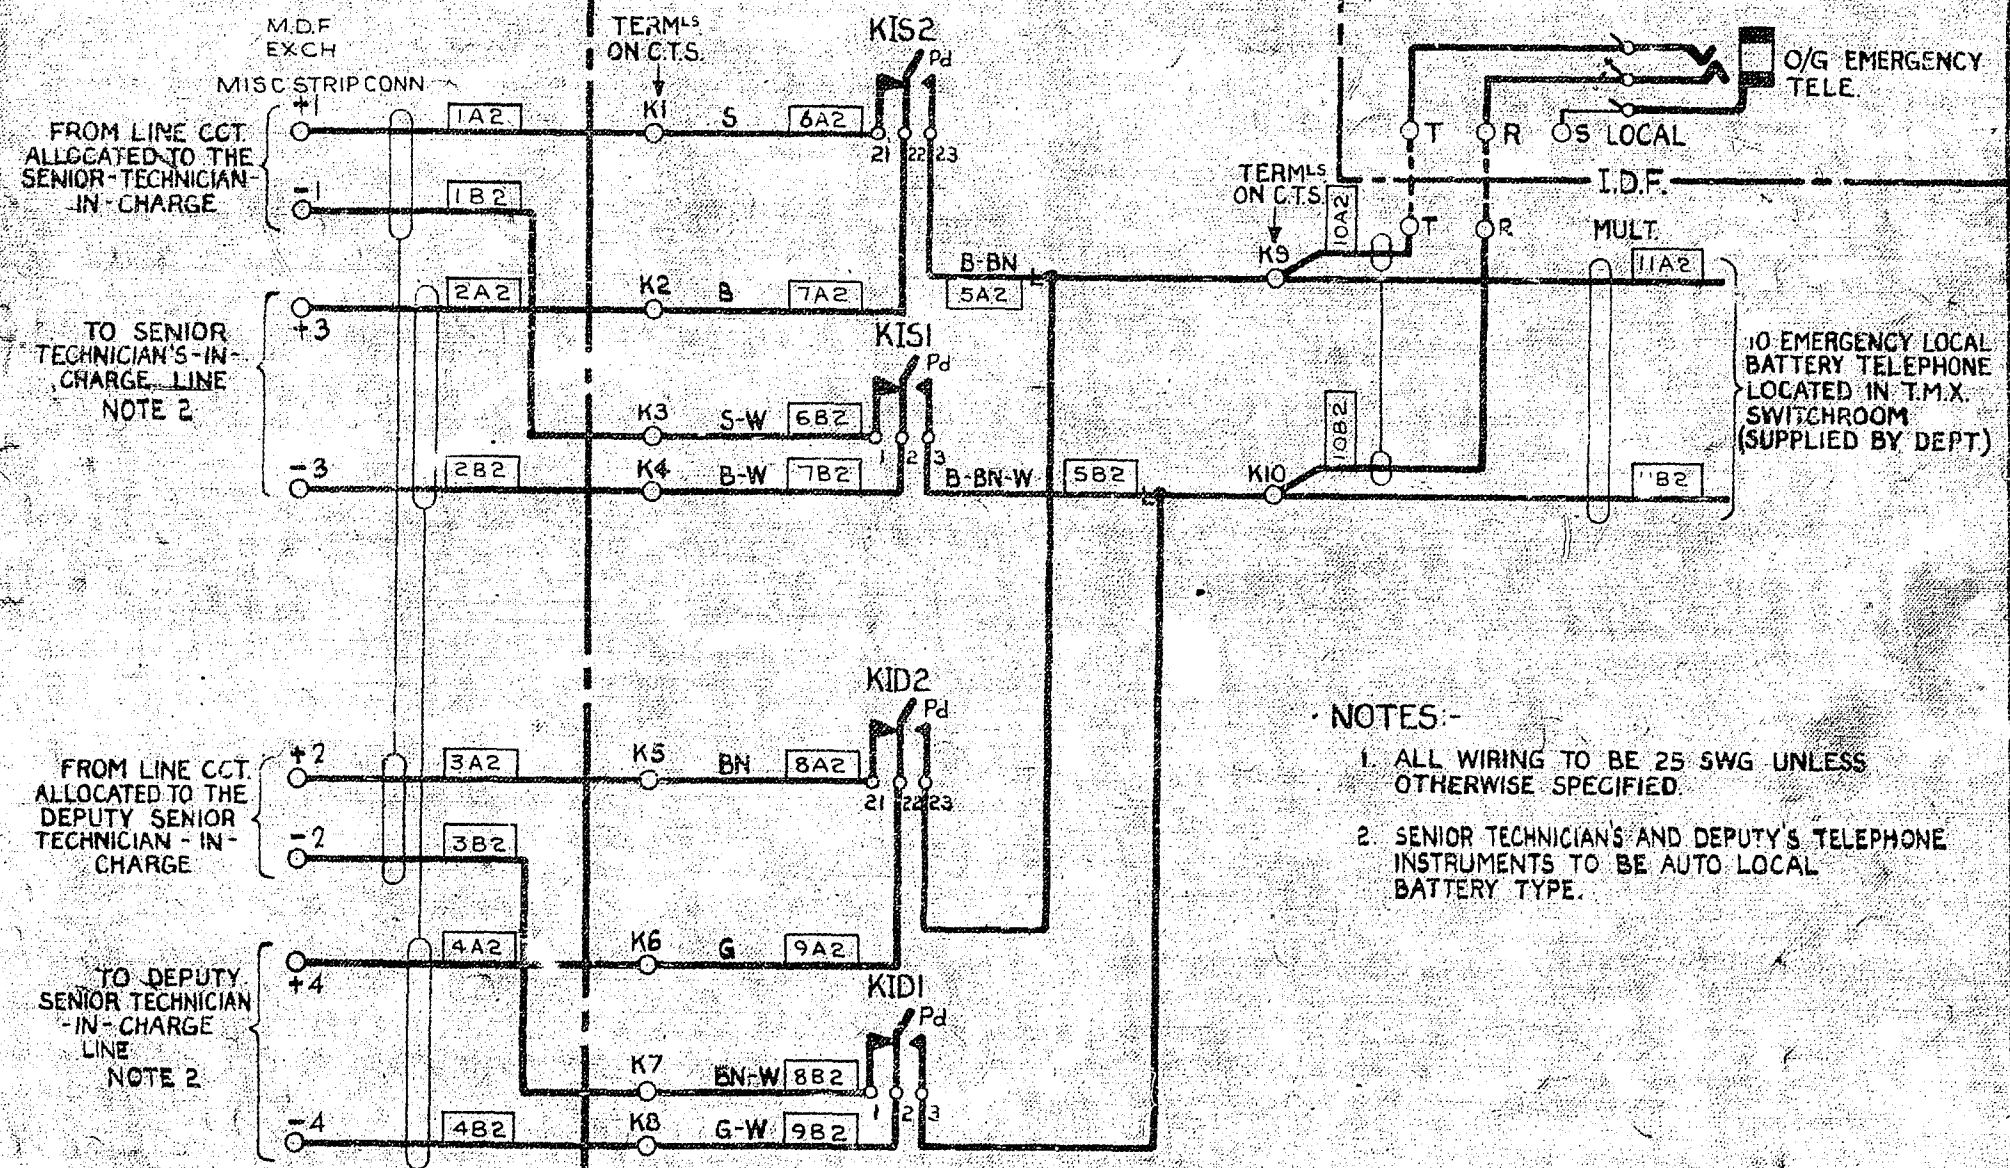

NOTES:-

1. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED.
2. SENIOR TECHNICIAN'S AND DEPUTY'S TELEPHONE INSTRUMENTS TO BE AUTO LOCAL BATTERY TYPE.

INTERCEPT SENIOR TECHNICIAN (KIS)	INTERCEPT DEPUTY TECHNICIAN (KID)
2	2

N.Z.I.P.O.  
 AMENDMENT PARTICULARS  
 (58280)  
 ISSUE DATE 10.2.67  
 GBW 19290  
 GSA 1114 (GBW19290)  
 SIZE F  
 50V E

EMERGENCY TECHNICIANS  
 TELEPHONE INTERCEPTION  
 (GEOTHERMAL AREAS)