


0
5 Centimetres
10
15
20
25
30

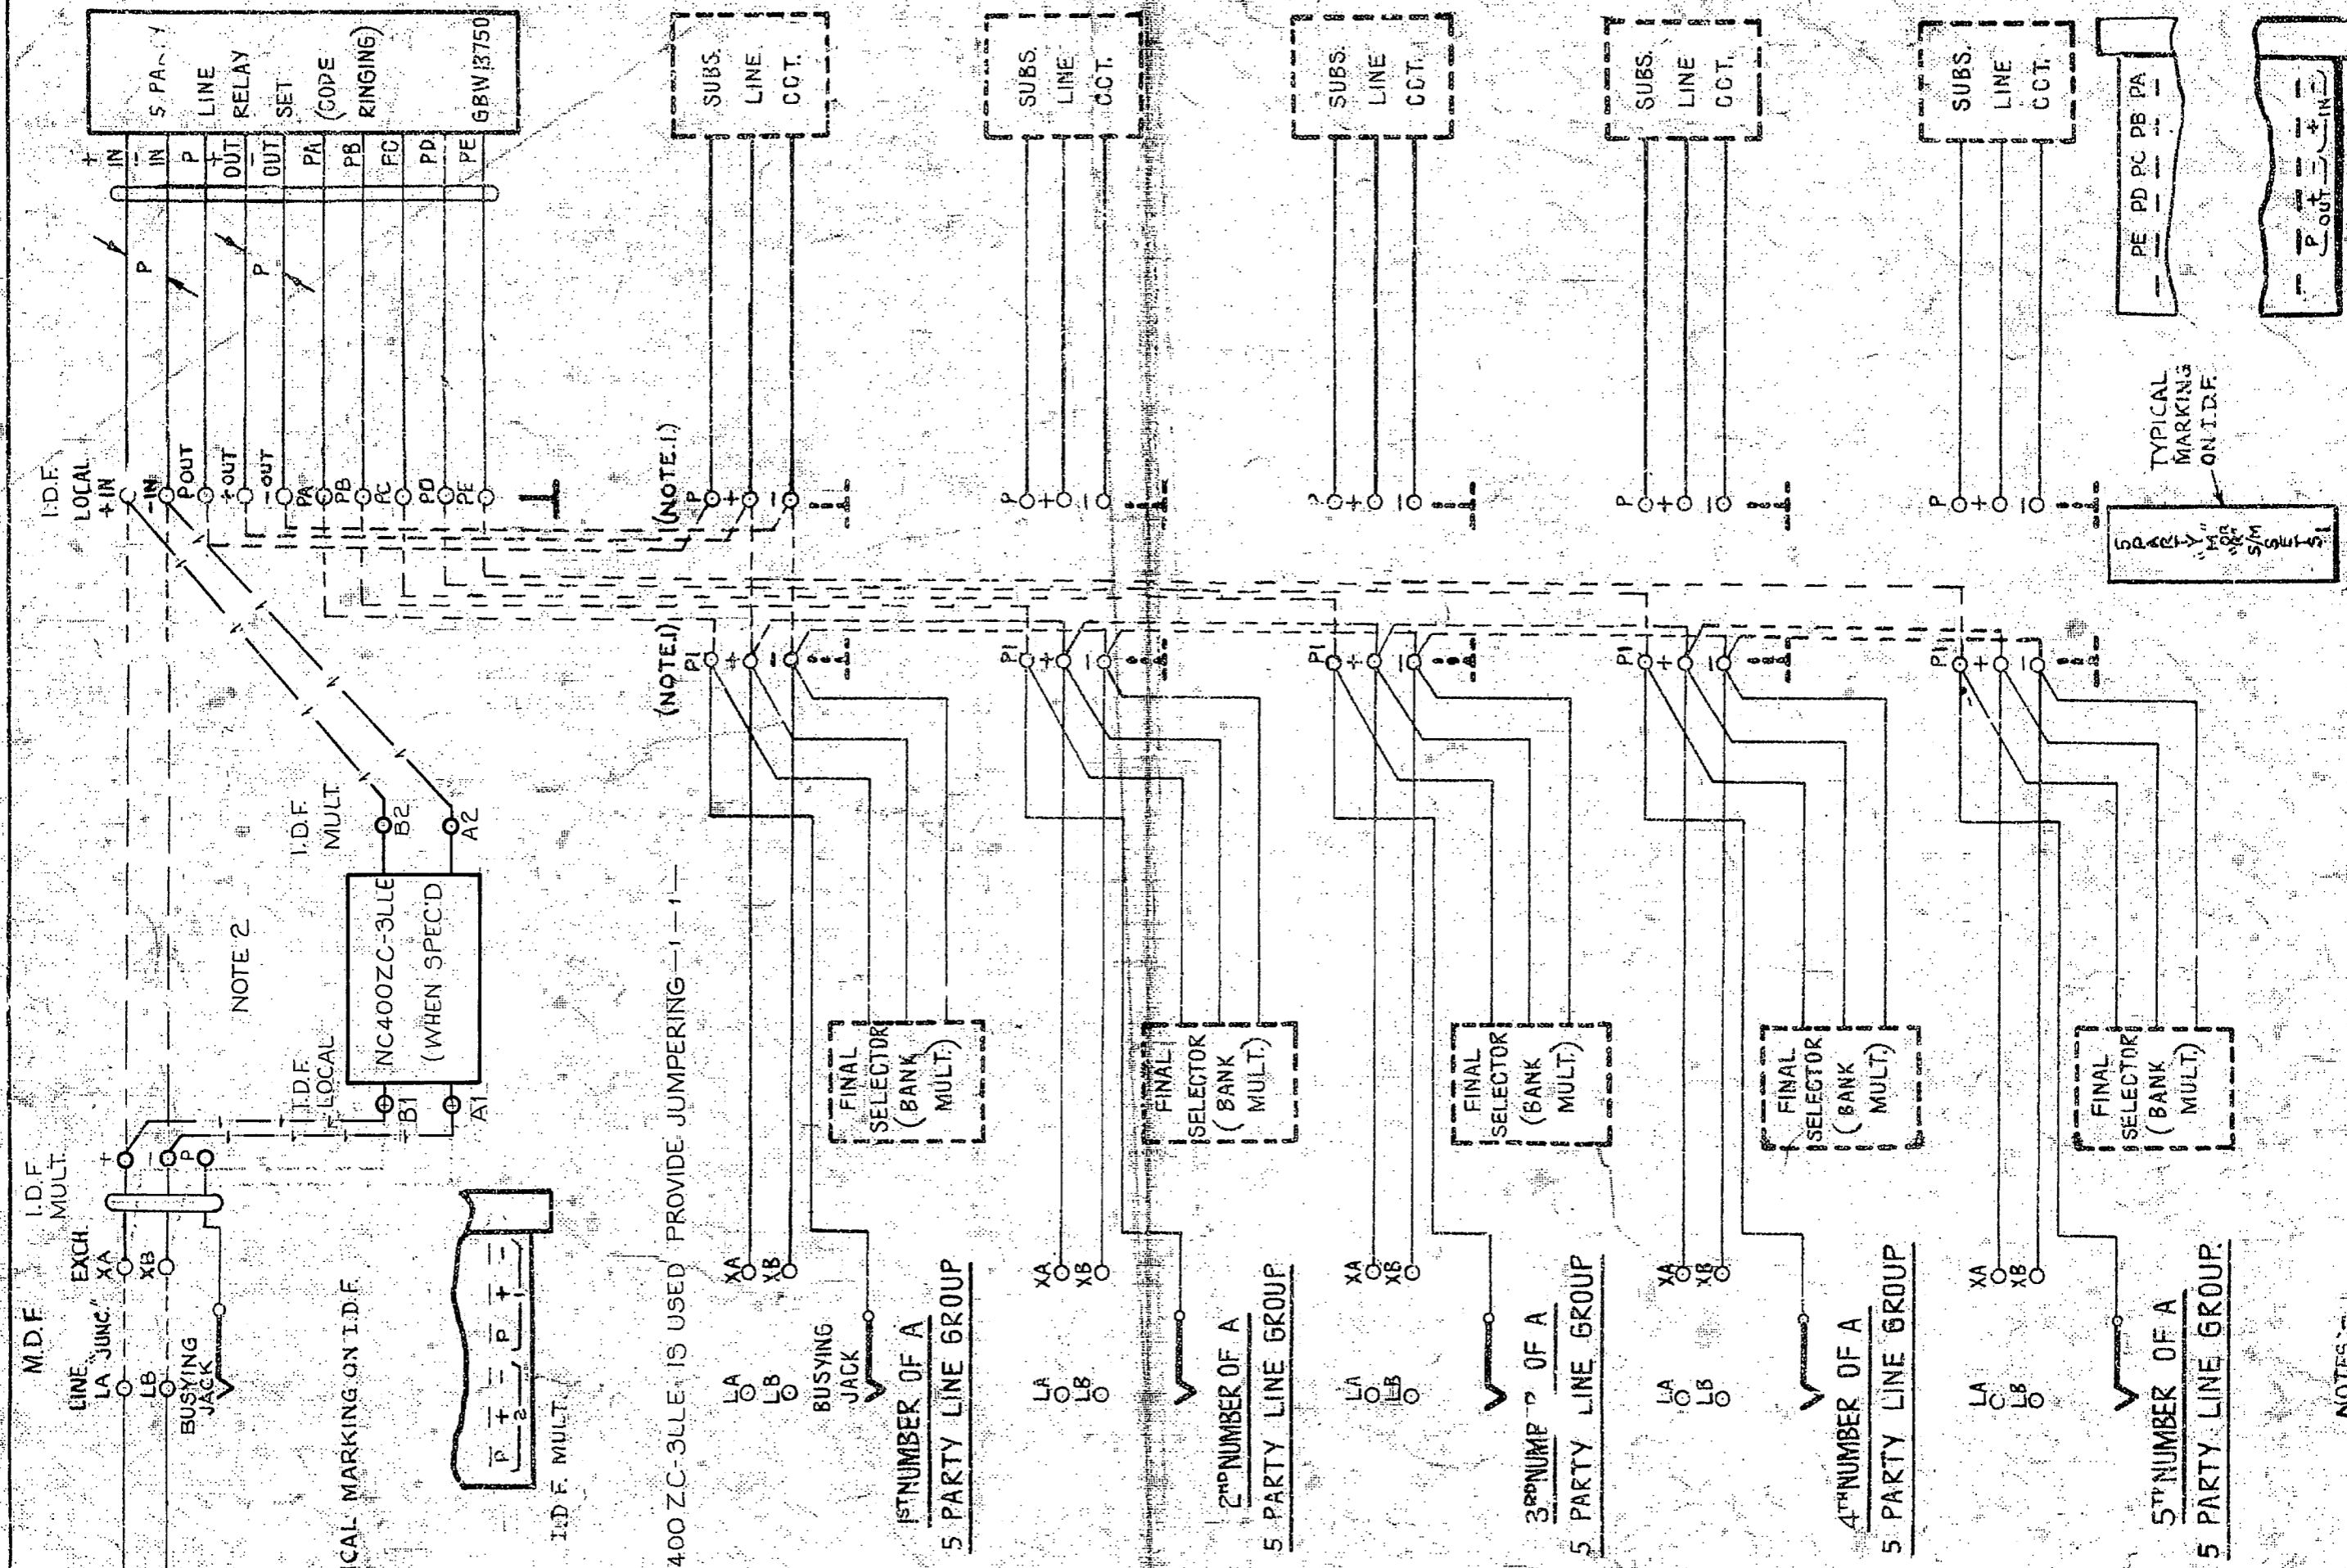

NOTE 2 WHEN 'NC400 ZC-3LLE' IS USED PROVIDE JUMPERING - 1 - 1 -

NOTES:
I.D.F. TERMINALS ARE THE NORMAL SUBS. LINE CCT TERMINATIONS. SEE LINE CCT CONNECTIONS DIAGRAM.

U.A.X. NZ 13		LINE RELAY SET M		FOR 5 PARTY C.B. LINES		LOOP DIALLING	
NEC LLE CONNECTION SHOWN		(70492)	2A	23.3.81			
I.D.F. JUMPERING AMENDED.		(42386)	2	1.4.55	CWA		
AMENDMENT PARTICULARS			ISSUE DATE	APPD			
NZ.P.O.					GBX 13750		