



FIG. A FOR NEW WORK SEE FIG. E

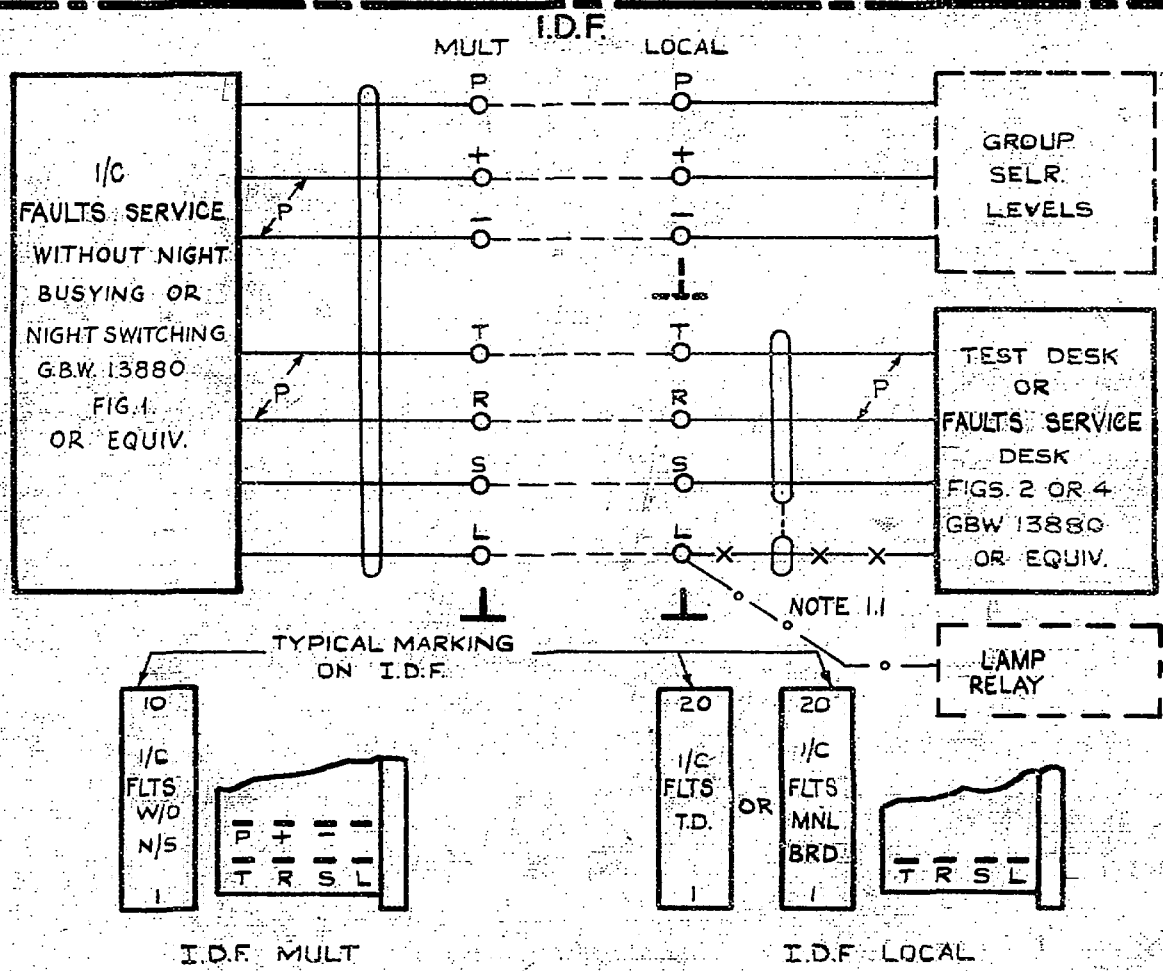

NOTES:- I. WHEN RELAY FOR INCREASED APPEARANCES IS REQUIRED EG. IN EXCESS OF 5 POSITIONS ADD CABLING SHOWN THUS AND DELETE CABLING SHOWN THUS OTHERWISE CABLE THUS

FIG. B FOR NEW WORK SEE FIG. F

SHEETS 4, 5 & 6 ADDED.						FAULTS SERVICE LINES TERMINATING ON TEST OR FAULTS SERVICE DESK WITH OR WITHOUT NIGHT SWITCHING TO AUTO-MANUAL BOARD S.C.S.	
TITLE AMENDED. NOTE & LAMP WERE NOT SHOWN (41099)				4	3.2.61		<i>[Signature]</i>
ISSUE ONLY ADVANCED (72157)				3	10.4.58		<i>[Signature]</i>
REF TO NIGHT BUSYING ADDED (40100)				2	11.10.54		<i>[Signature]</i>
(31665)				1	4.5.54	<i>[Signature]</i>	
AMENDMENT PARTICULARS				ISSUE	DATE	APPD.	
NZPO				DRAWN R.W.S. TRACED I.F. CHECKED R.W.S. APPROVED B.W.D.	GBX 13880		
						SHT 1-6	

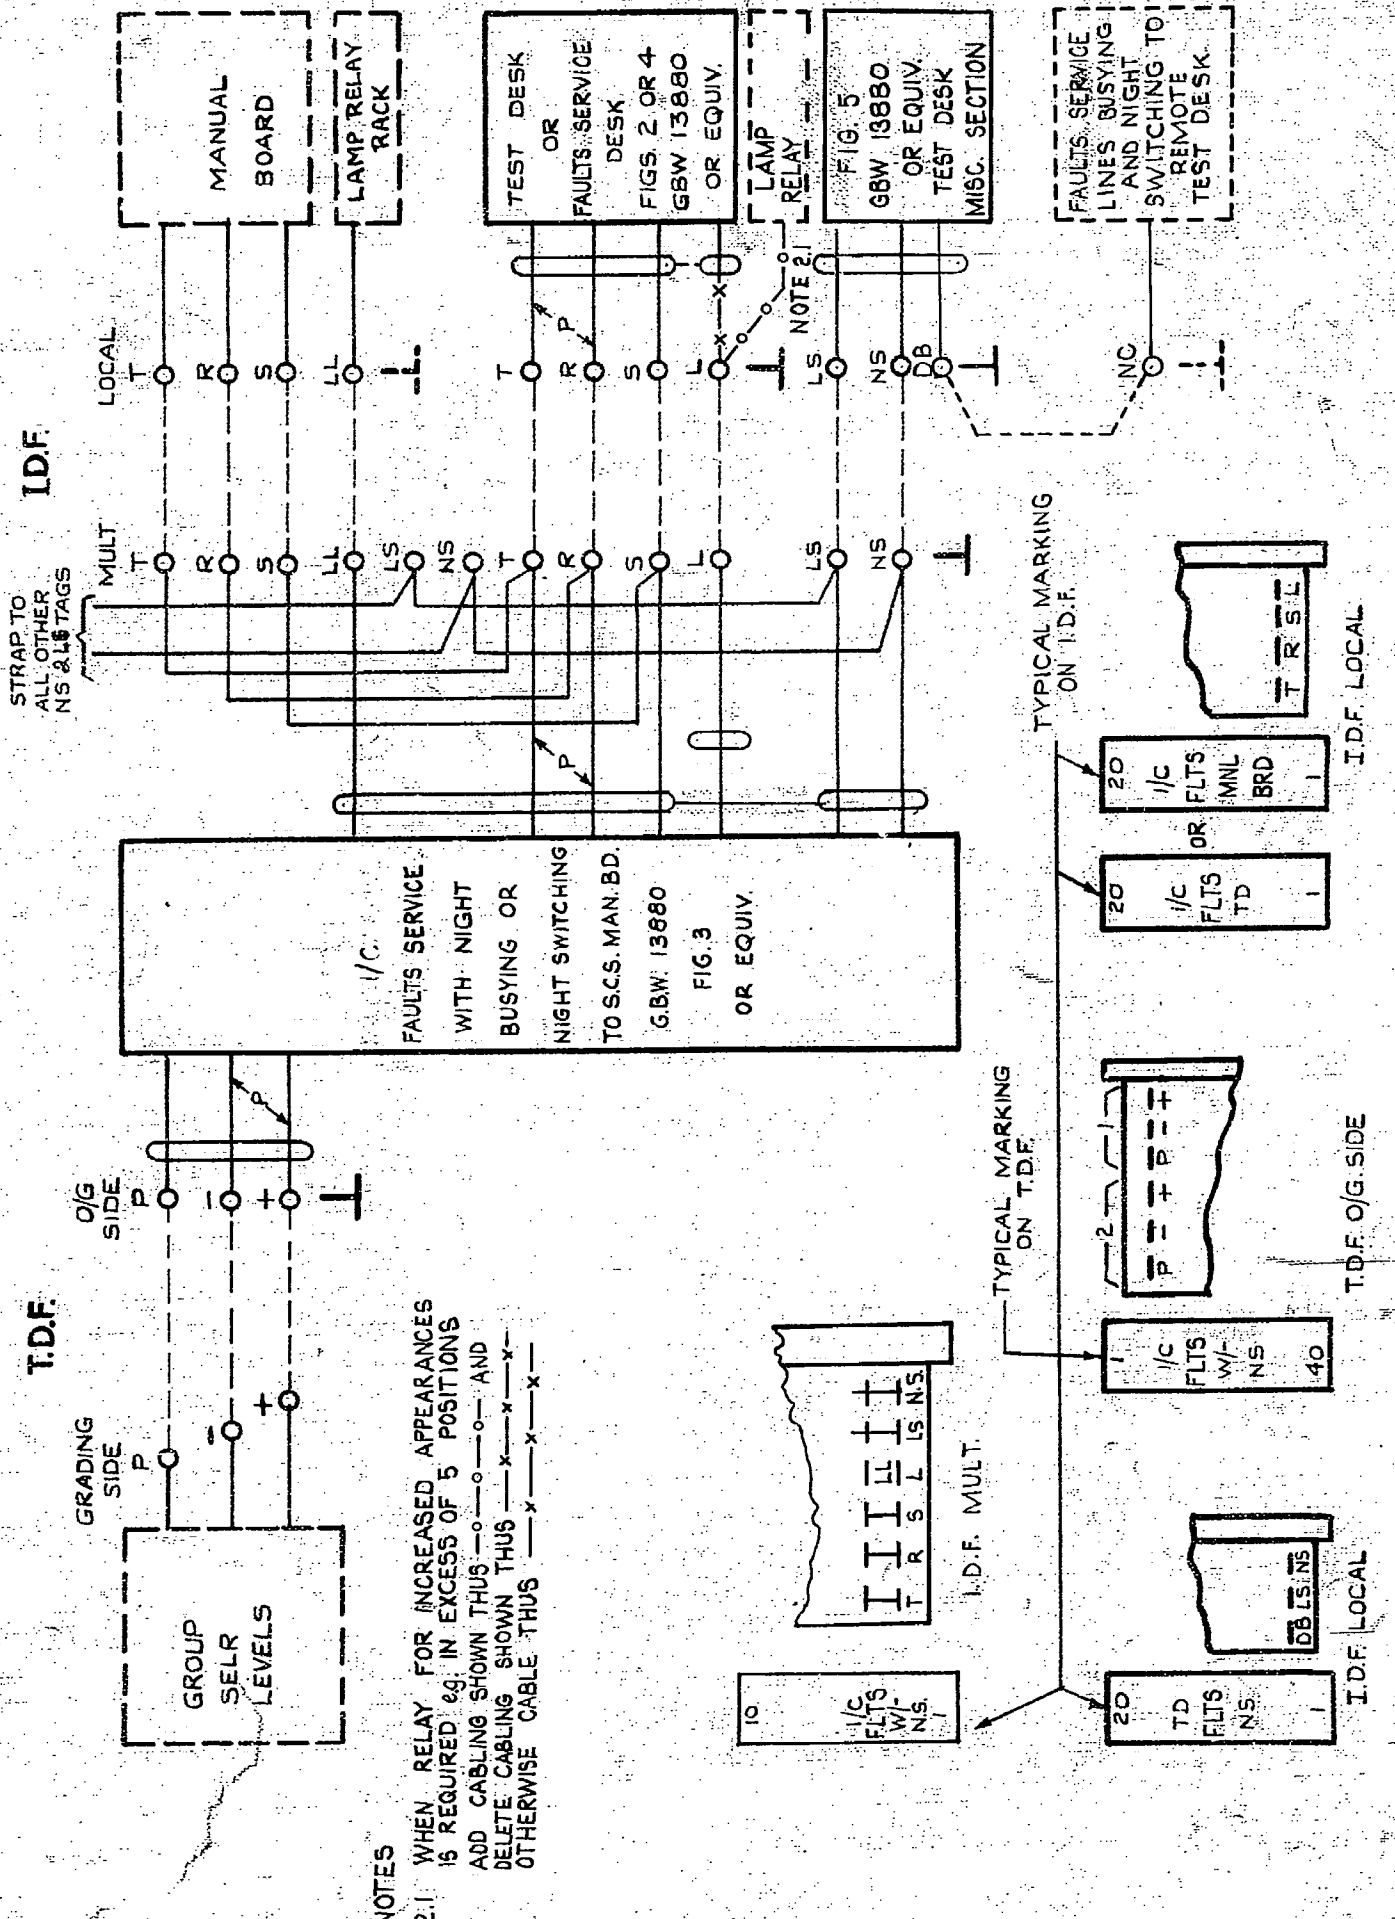

NOTES

2.1 WHEN RELAY FOR INCREASED APPEARANCES IS REQUIRED: eg. IN EXCESS OF 5 POSITIONS ADD CABLING SHOWN THUS $\text{---} \text{---} \text{---} \text{---} \text{---} \text{---} \text{---}$ AND DELETE CABLING SHOWN THUS $\text{---} \text{---} \text{---} \text{---} \text{---} \text{---} \text{---}$ OTHERWISE CABLE THUS $\text{---} \text{---} \text{---} \text{---} \text{---} \text{---} \text{---}$

FIG. C FOR NEW WORK SEE FIG. G

SHEETS 4.5 & 6 ADDED (41099)		4	3.2.61	<i>W.P.B.</i>	FAULTS SERVICE LINES TERMINATING ON TEST OR FAULTS SERVICE DESK WITH OR WITHOUT NIGHT SWITCHING TO AUTO-MANUAL BOARD S.C.S.
TITLE AMENDED NOTE & LAMP LEAD WERE NOT SHOWN.		3	10.4.58	<i>W.P.B.</i>	
REMOTE TEST DESK COT. & CABLE TO DB TERMINAL ADDED (72157)		2	12.10.54	<i>W.P.B.</i>	
REFS. TO NIGHT BUSYING ADDED (40100)		1	4.5.54	<i>W.P.B.</i>	
REFS. TO NIGHT BUSYING ADDED (31665)					
AMENDMENT PARTICULARS		ISSUE	DATE	APPD.	S
NZ.P.O.		DRAWN R.W.S.	TRACED I.F.	CHECKED R.W.S.	APPROVED E.W.D.
GBX 13880					SHT2-6

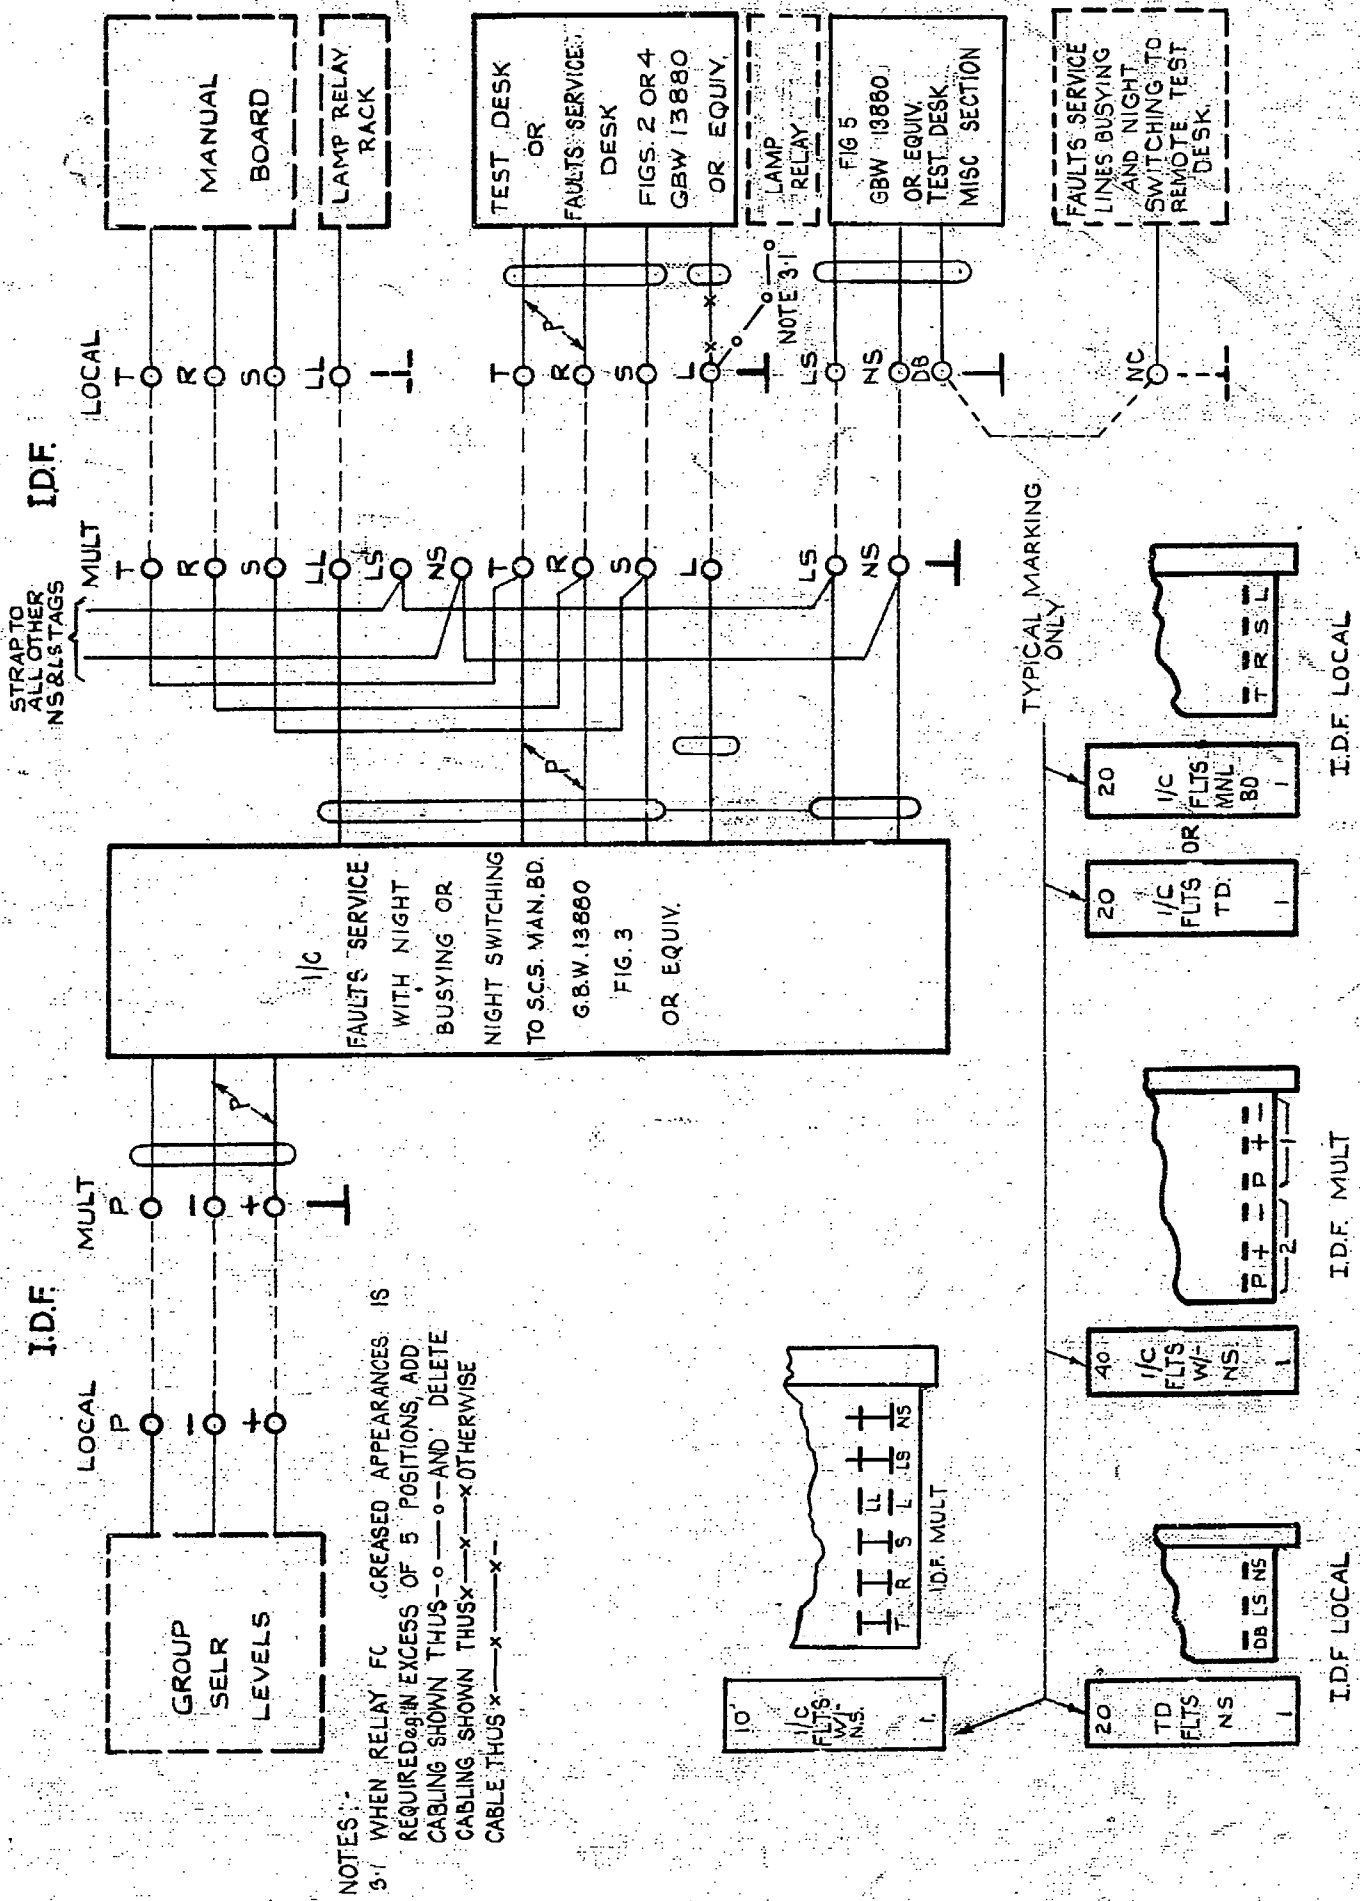


FIG.D FOR NEW WORK SEE FIG.H

SHEETS 4, 5, & 6 ADDED (41099)		4	3-2-61	<i>AW</i>
TITLE AMENDED. NOTE & LAMP LEAD WERE NOT SHOWN				
REMOTE TEST DESK CCT. & CABLE TO DB TERMINAL ADDED (72157)		3	10-4-58	<i>AW</i>
REFS. TO NIGHT BUSYING ADDED (40100)		2	12-10-54	<i>AW</i>
(31665)		1	4-5-54	<i>AW</i>
AMENDMENT PARTICULARS		ISSUE	DATE	APPD.
N.Z.P.O.	DRAWN R.W.S.	TRACED I.F.	CHECKED R.W.S.	APPROVED E.W.D.

FAULTS SERVICE LINES
 TERMINATING ON TEST
 OR FAULTS SERVICE DESK
 WITH OR WITHOUT NIGHT SWITCHING
 TO AUTO-MANUAL BOARD S.C.S.

GBX 13880

SHT 3-6


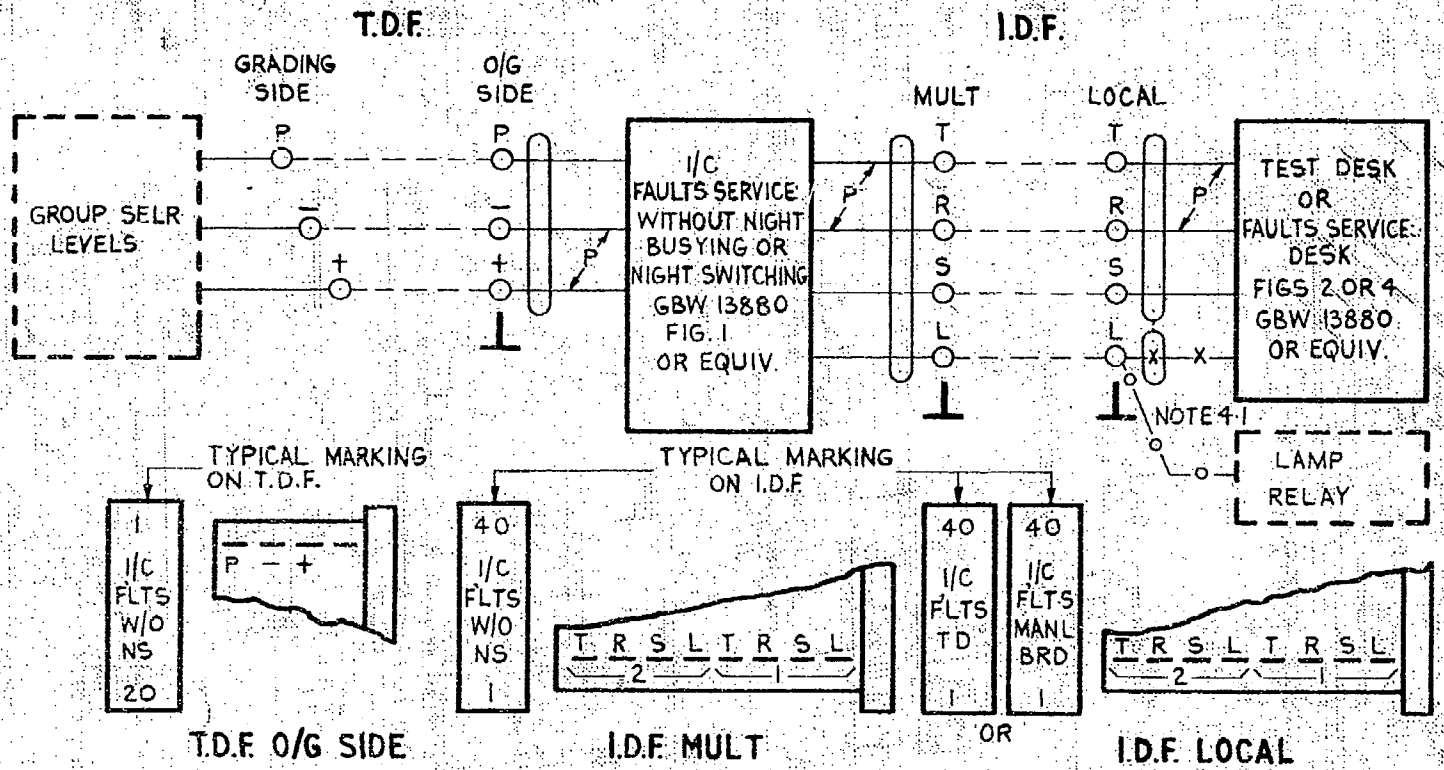


FIG. E.

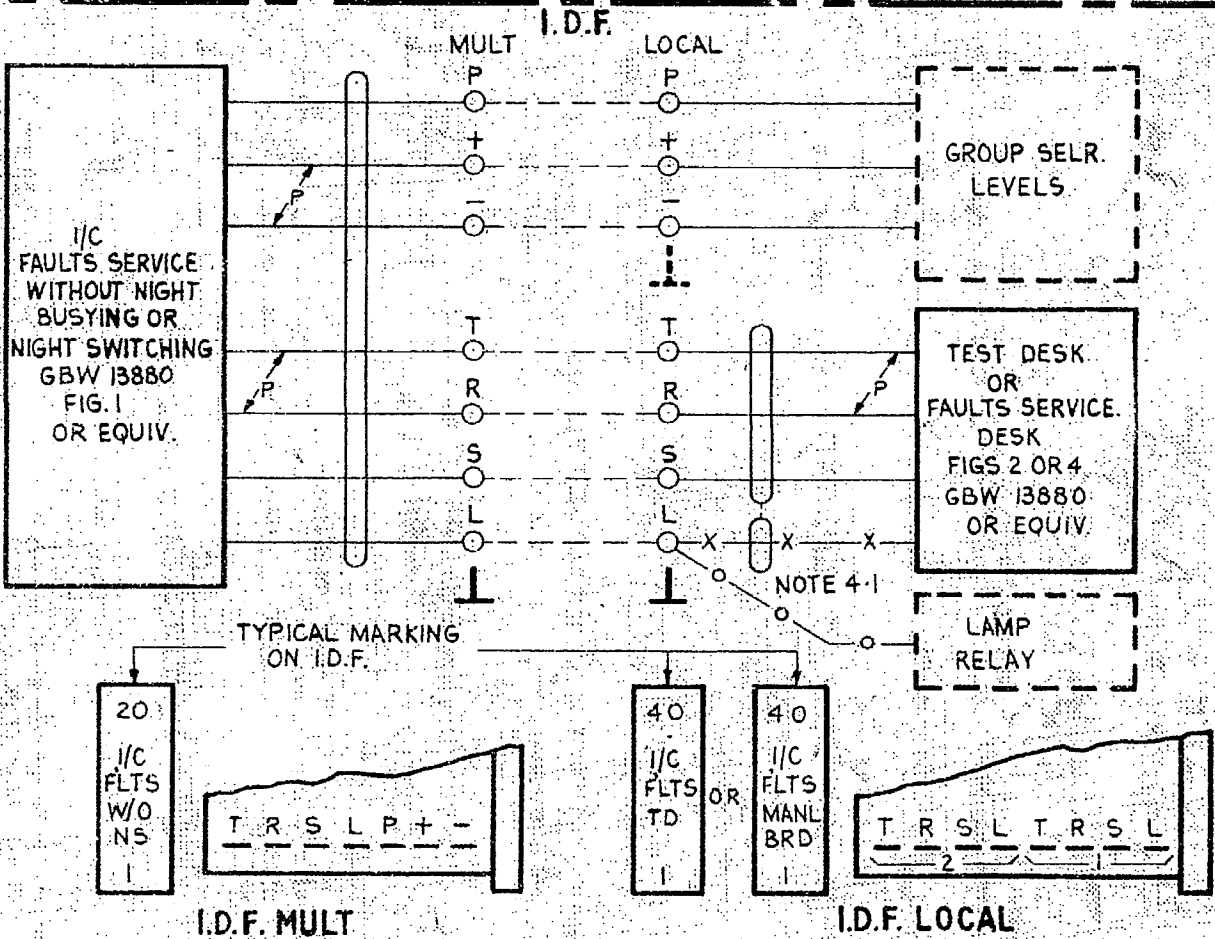

NOTES

4-1 WHEN RELAY FOR INCREASED APPEARANCES IS REQUIRED E.G. IN EXCESS OF 5 POSITIONS ADD CABLING SHOWN THUS —o—o— AND DELETE CABLING THUS —X—X— OTHERWISE CABLE THUS —X—

FIG. F.

					<p>FAULTS SERVICE LINES TERMINATING ON TEST OR FAULTS SERVICE DESK OR EQUIV WITH OR WITHOUT NIGHT SWITCHING TO AUTO-MANUAL BOARD S.C.S</p>	
		(41099)	4	3.2.61		
AMENDMENT PARTICULARS			ISSUE	DATE	APP	REF
N.Z.P.O.			DRAWN	CHECKED	WIRING	CIRCUIT
			G.R.S.	S.K.S.		
					<p>GBX 13880</p>	
					<p>SHEET 4-6</p>	


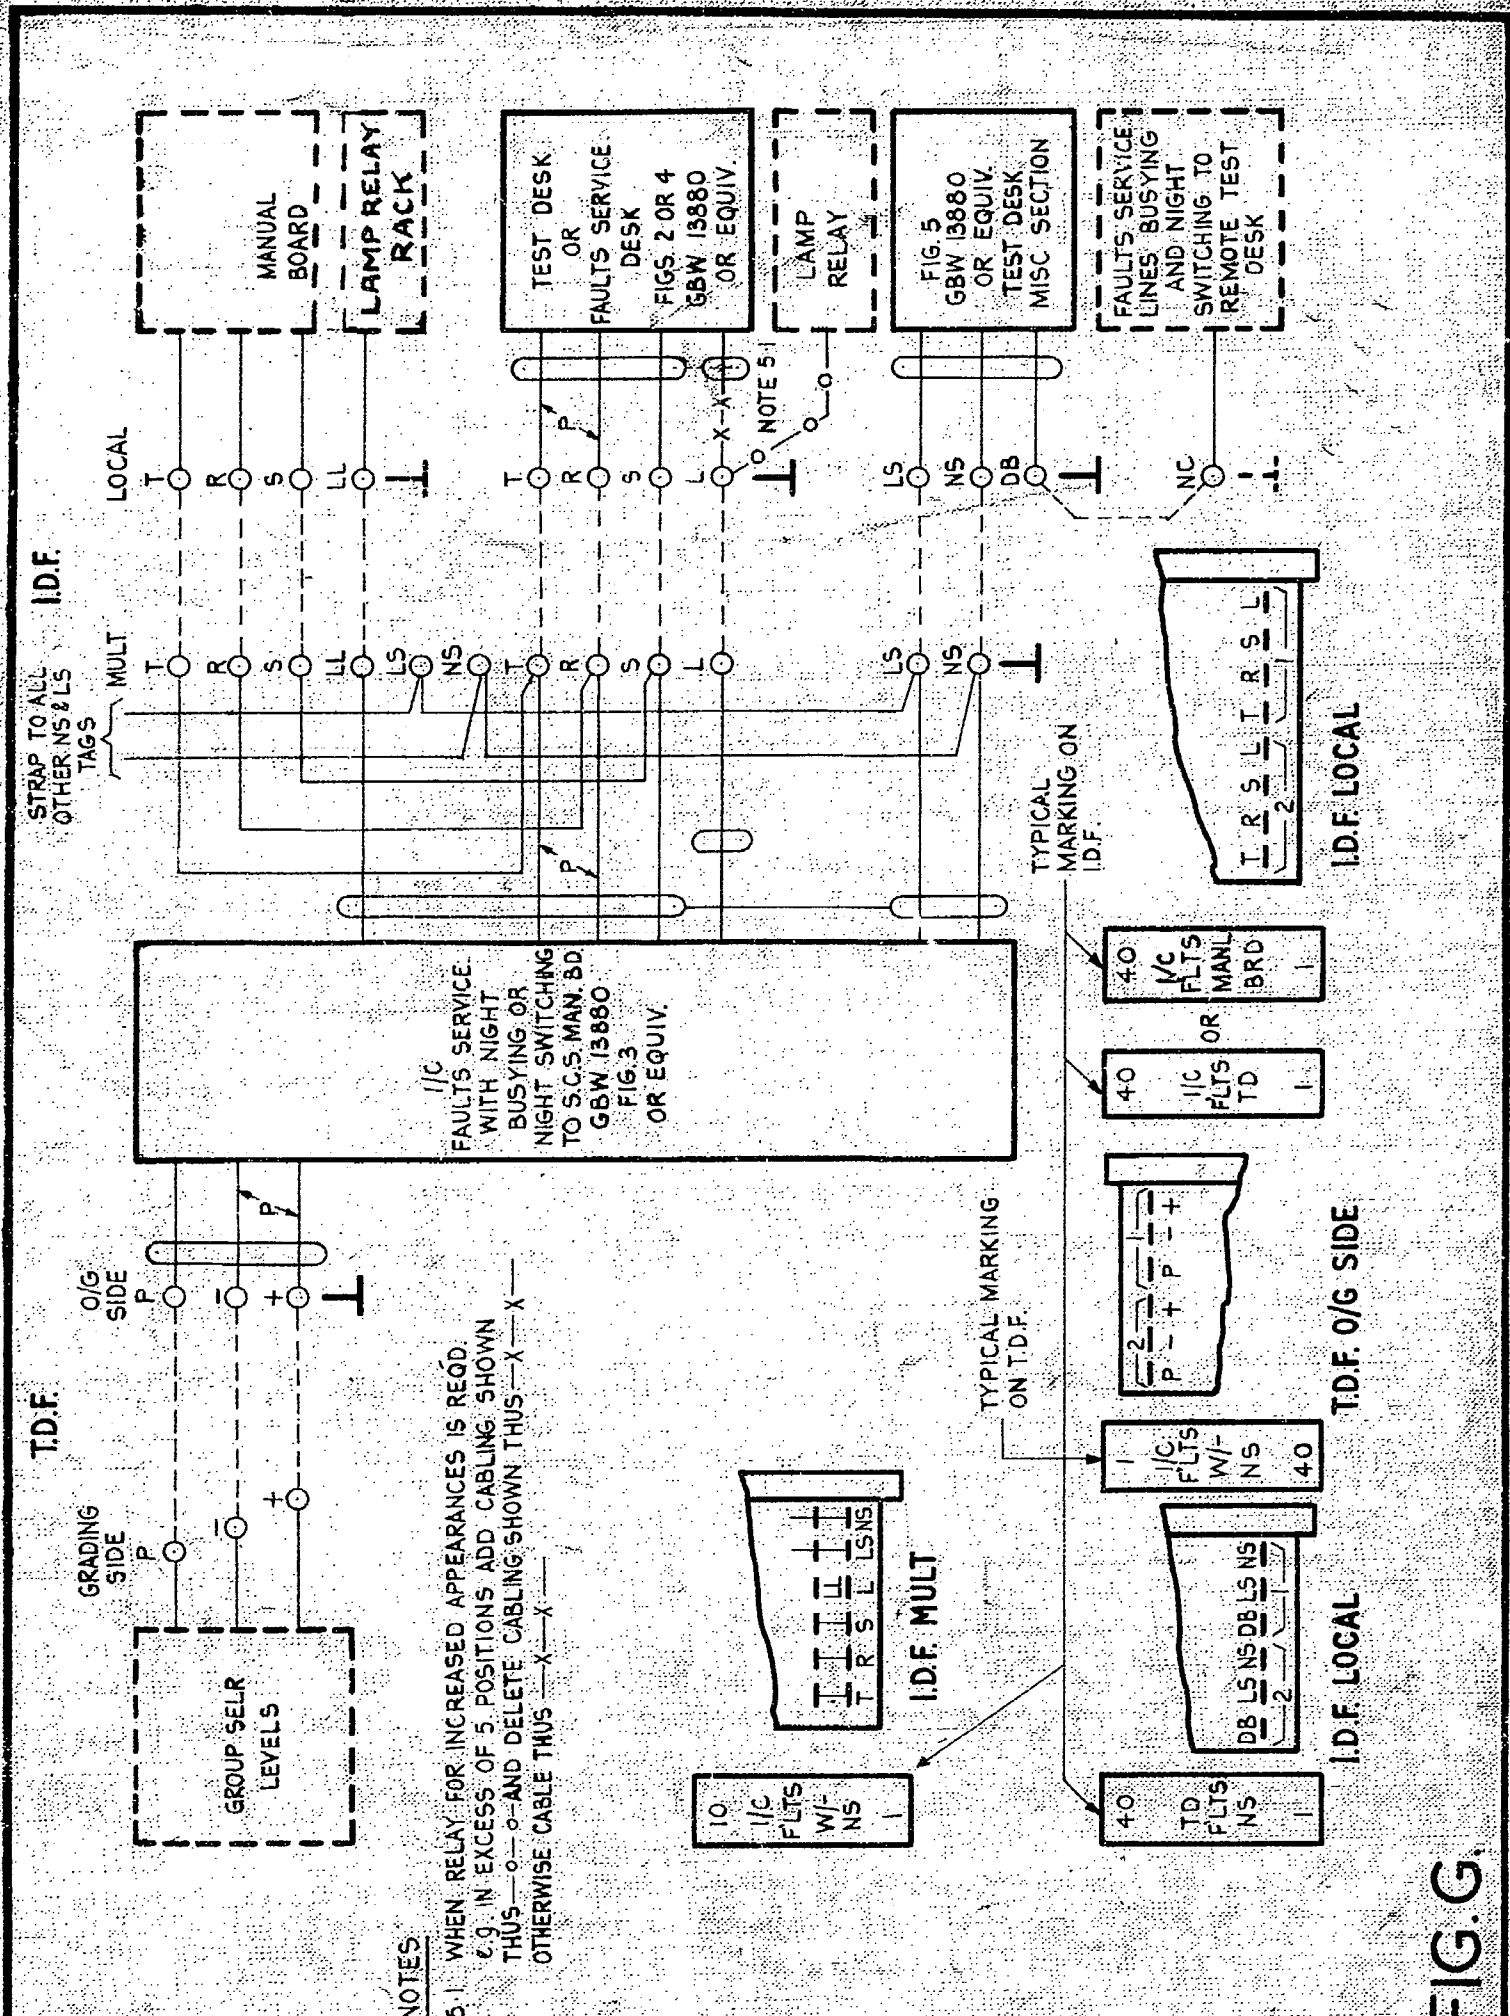


FIG. G.

AMENDMENT PARTICULARS				ISSUE	DATE	APP.	REF. :-	S
				(41099)	4	3.2.61		
N.Z.P.O.				DRAWN	CHECKED	WIRING	CIRCUIT	
				G.R.S.	S.K.S.			
				GBX 13880				
				FAULTS SERVICE LINES TERMINATING ON TEST OR FAULTS SERVICE DESK OR EQUIV. WITH OR WITHOUT NIGHT SWITCHING TO AUTO-MANUAL BOARD S.C.S.				
				SHEET 5-5				

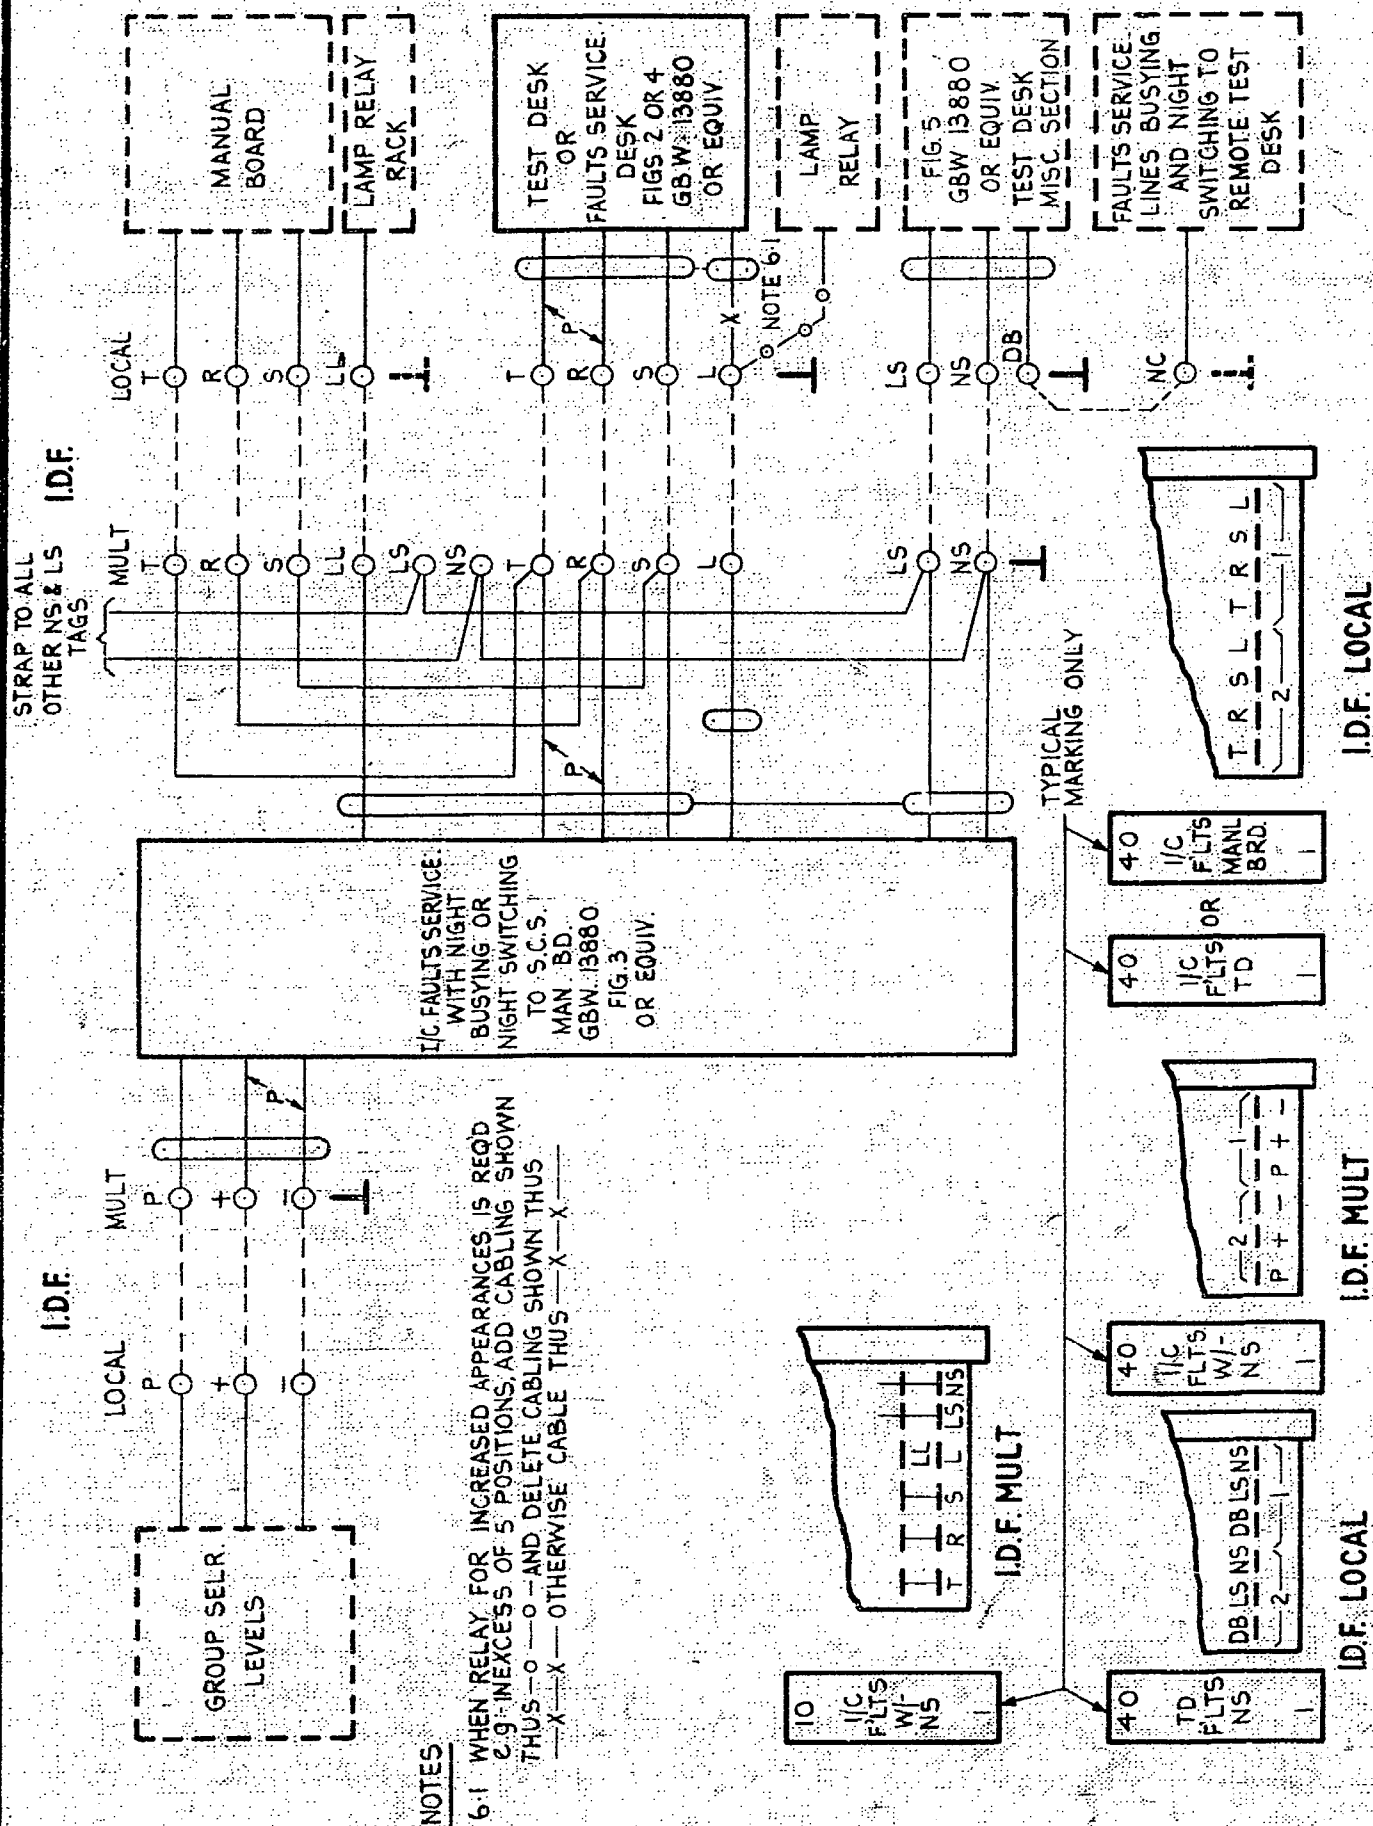


NOTES


6.1 WHEN RELAY FOR INCREASED APPEARANCES IS REQD. IN EXCESS OF 5 POSITIONS, ADD CABLING SHOWN THUS - 0 - 0 - AND DELETE CABLING SHOWN THUS - X - X - OTHERWISE CABLE THUS - X - X -

I.C. FAULTS SERVICE WITH NIGHT BUSYING OR NIGHT SWITCHING TO S.C.S. MAN. BD. GBW. 13880 FIG. 3 OR EQUIV.

GROUP SELR. LEVELS



STRAP TO ALL OTHER NS & LS TAGS

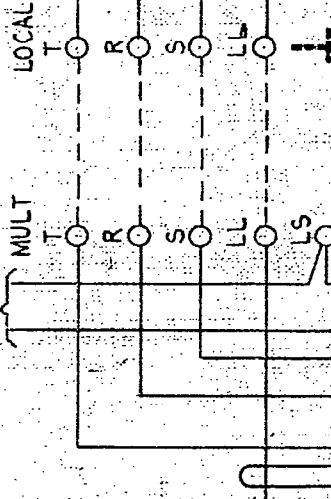


TEST OR FAULTS SERVICE DESK FIGS 2 OR 4 GBW 13880 OR EQUIV.

LAMP RELAY


FIG. 5 GBW 13880 OR EQUIV. TEST DESK MISC. SECTION

FAULTS SERVICE LINES BUSYING AND NIGHT SWITCHING TO REMOTE TEST DESK


TYPICAL MARKING ONLY

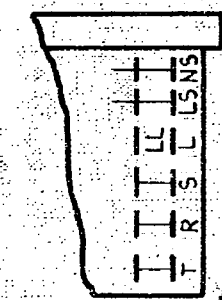





I.D.F. MULT



I.D.F. LOCAL



I.D.F. MULT

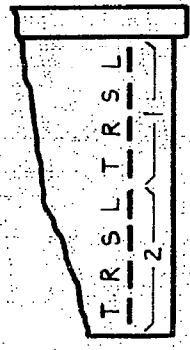

I.D.F. LOCAL

FIG.H.

N.Z.P.O.	DRAWN G.R.S.	CHECKED G.R.S.	WIRING CIRCUIT G.R.S.
AMENDMENT PARTICULARS	ISSUE	DATE	APP
(41099)	4	3/2/81	[Signature]

FAULTS SERVICE LINES TERMINATING ON TEST OR FAULTS SERVICE DESK OR EQUIV WITH OR WITHOUT NIGHT SWITCHING TO AUTO-MANUAL BOARD S.C.S.

GBX 13880