
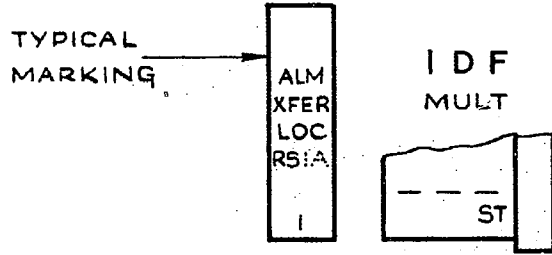


I.D.F.

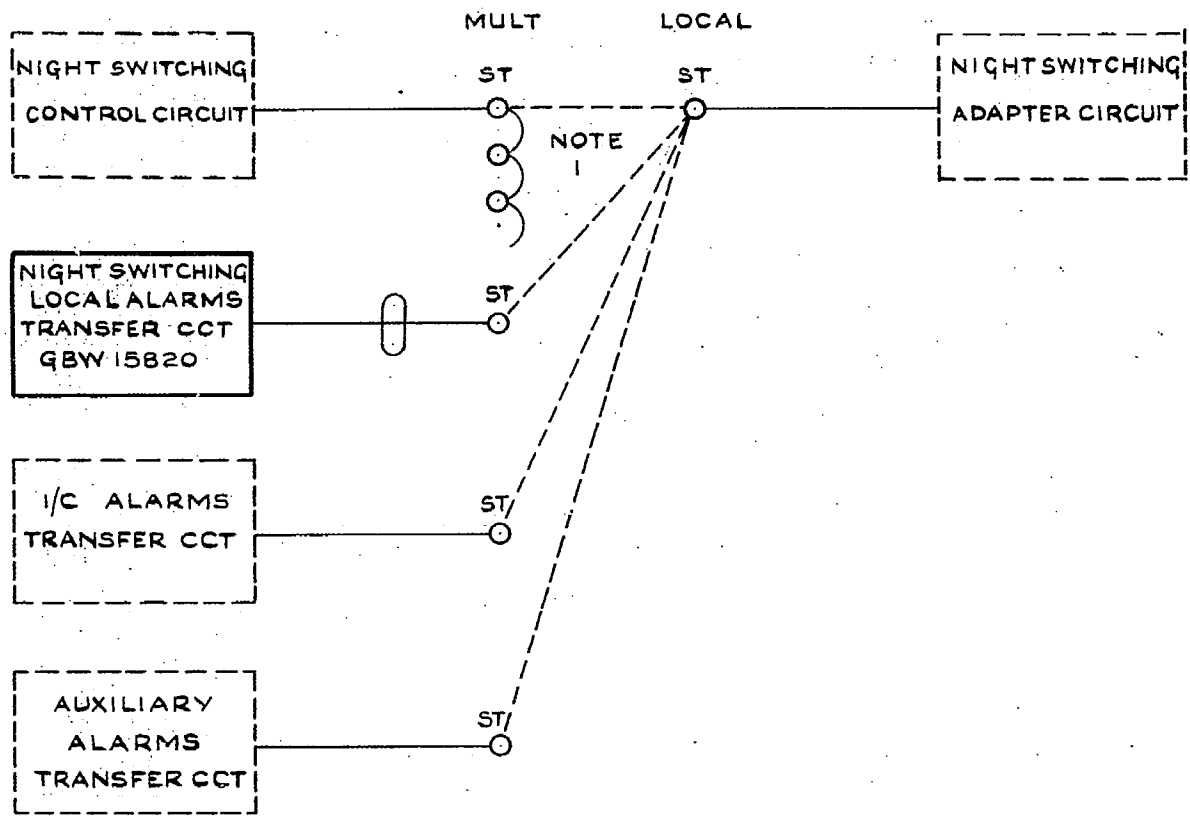

NOTES

- STRAPPING AND JUMPERING OF CONTROL CIRCUITS AND JUMPERING OF ALARM TRANSFER CIRCUITS TO BE ARRANGED TO PROVIDE AN EVEN DISTRIBUTION OF EACH TYPE OF CIRCUIT OVER THE NUMBER OF EQUIPPED ADAPTER CIRCUITS.

				NIGHT SWITCHING LOCAL ALARMS TRANSFER CIRCUIT DAY GROUP CENTRE TO TMX 2000 TYPE.		
(56788)				1	20.2.62	<i>[Signature]</i>
AMENDMENT PARTICULARS				ISSUE	DATE	APPD
				REF. ES.117 SCHEME C		
				GBX 15820		
NZ.P.O.		DRAWN	CHECKED	WIRING	CIRCUIT	