
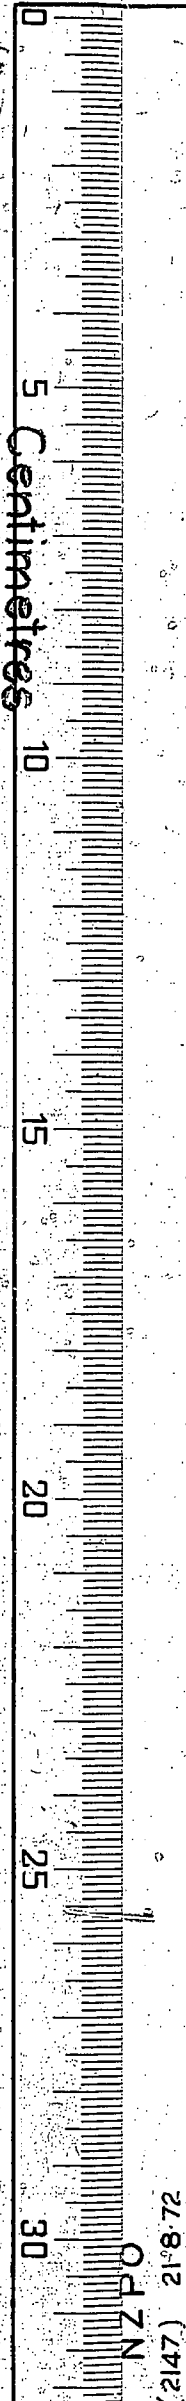


RELAY CODES & COMPONENTS LIST, **GBW 16870**

8 AND 80 VOLTS SUPPLY-
TEST DESK OR TEST RACK

RELAY	B.C.C. CODE	DIAG. FIG.	NOTES	COMPT. DESIGNATION	B.P.O. CODE	DIAG. FIG.	NOTES	
			NO RELAYS	R1			1K 5% MR8 OR EQUIV - WELWYN OR ELECTROSIL	
				R2				1.25K 5% MR8 OR EQUIV
				D1				CV7030-BY103-S8CNJ-S8MI
				D2				CV7030-BY103-S8CNJ-S8MI
				D3				BZY96 C4V7
				D4				BZY96 C4V7
				D5				BZY95 C36
				D6				BZY95 C36
			D7				BZY96 C7V5-CV7163	
				C1			FLESSEY 439/1/1432/471-OR ERIE-21104-100-047-0A-0161	

NOTES: - A SPECIAL FACTORS OF SAFETY. B SPECIAL ADJUSTMENTS. C CIRCUIT POINTS OR MODIFICATIONS

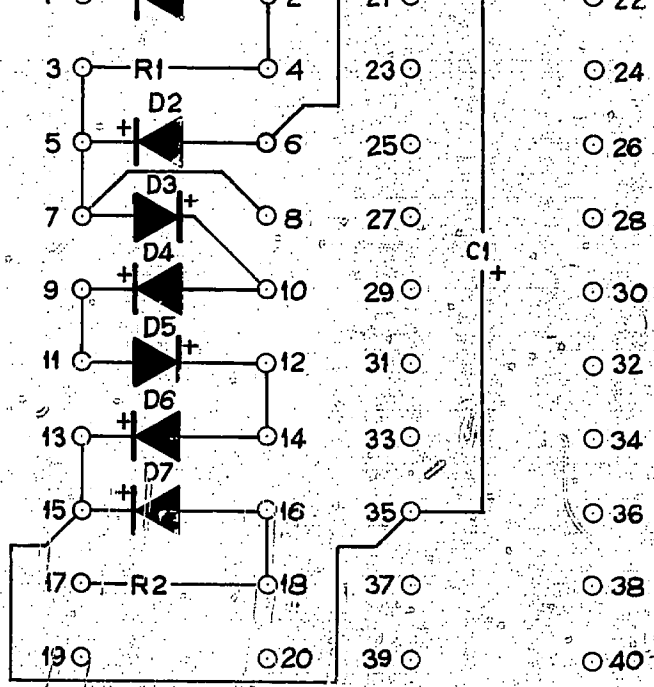

NZPO (2147) 21-8-72

ISSUE 1 R1 & R2 CHANGED TO 2 WATT RATING	ISSUE 2	ORIGINATED BY AT&EC
		DATE 29-12-70
		SIGNED FOR COMMITTEE HB