
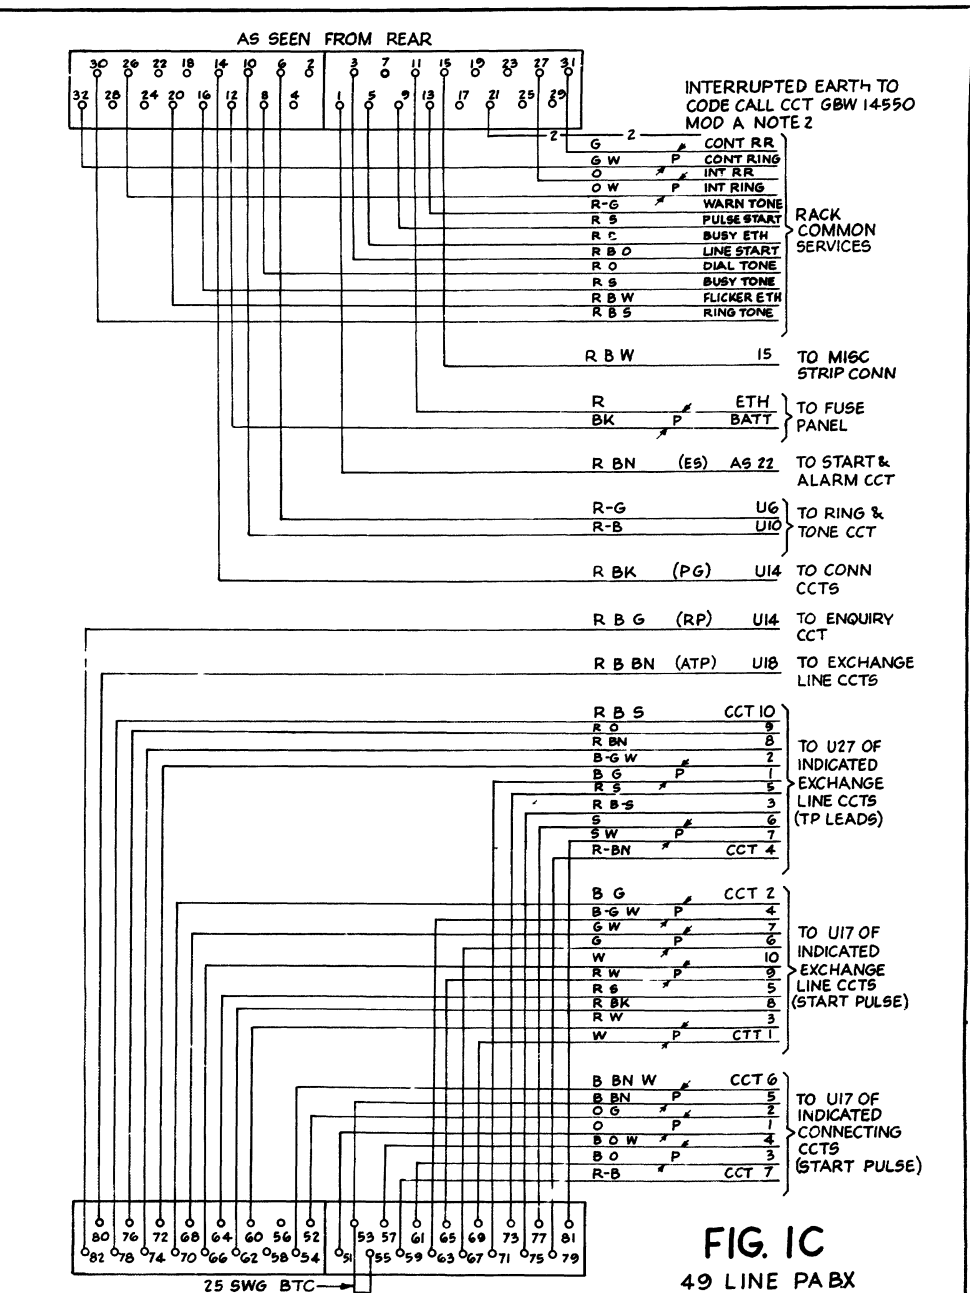
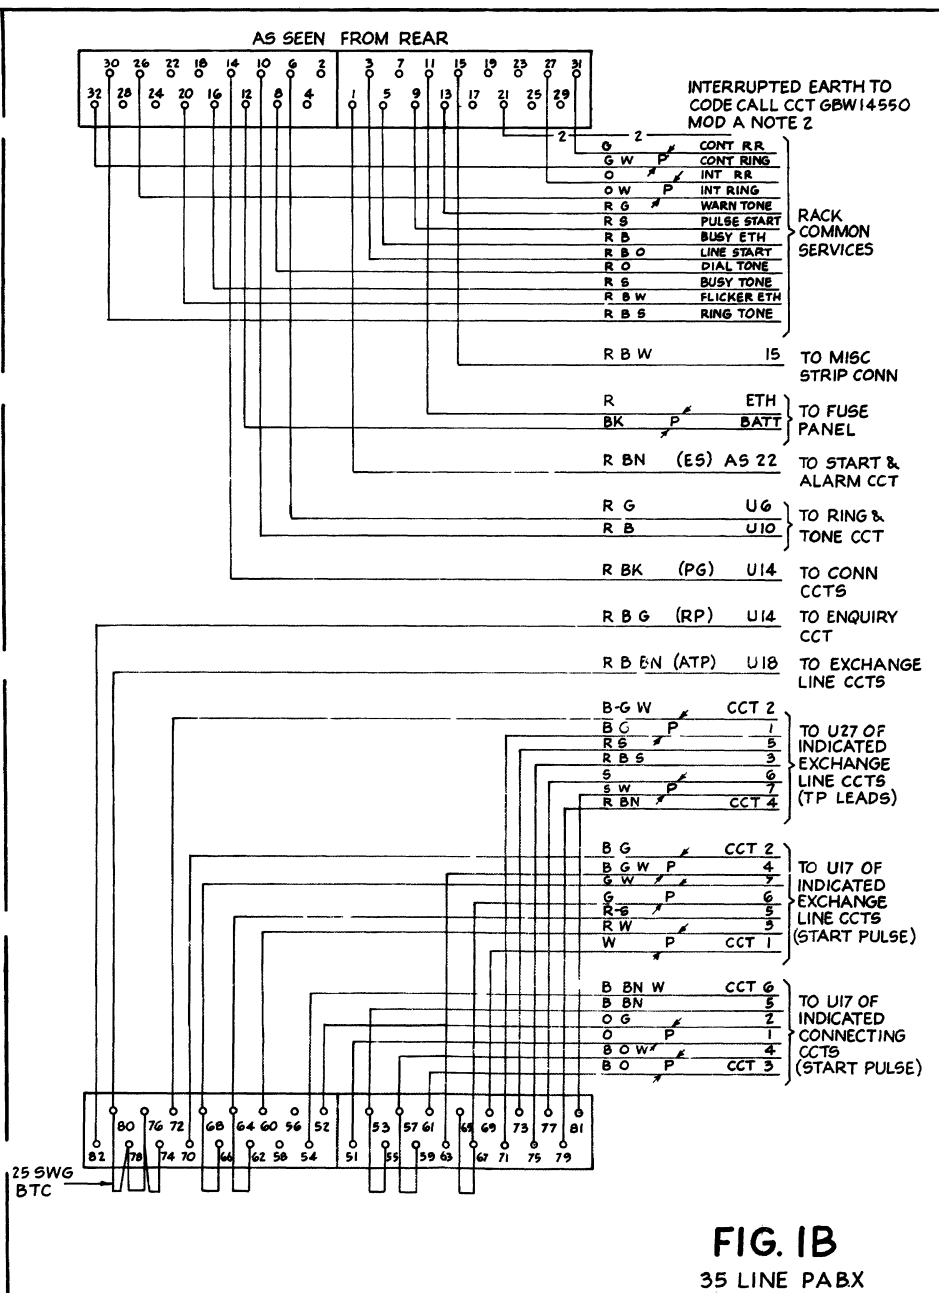


0  
5 Centimetres  
10  
15  
20  
25  
30

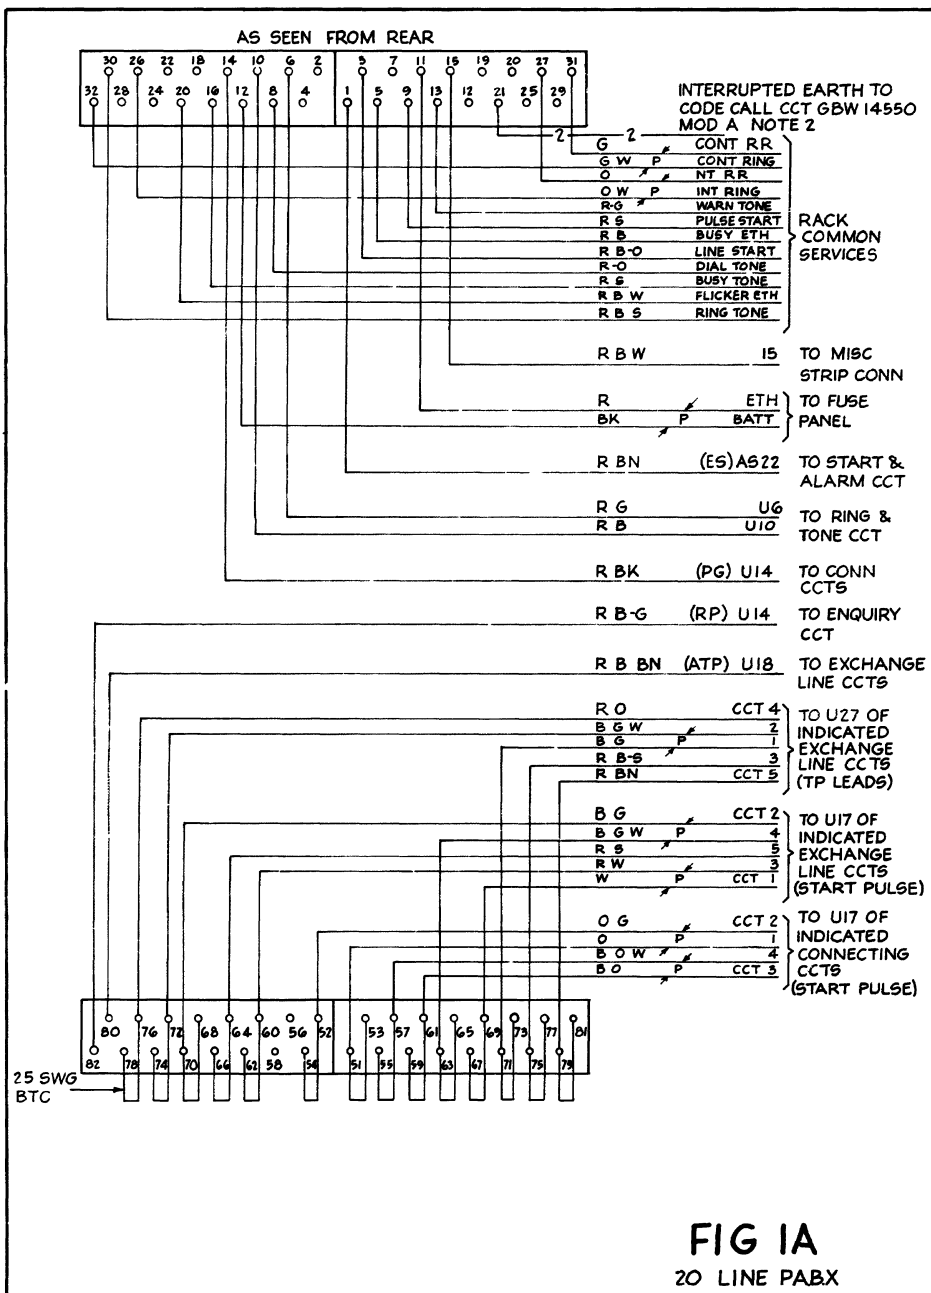

- NOTES -**
- 1 ALL WIRING TO BE 25 SWG
  - 2 PROVIDE CONNS -2-2-1 WHEN CODE CALL SERVICE REQUIRED

20, 35 & 49 LINE PABX'S			
PULSE CIRCUIT			
WITH AUXILIARY SERVICES			
(23274)		A	13 6 60 LWA
AMENDMENT	PARTICULARS	ISSUE DATE	APPR
NZPO	DRAWN JB	CHECKED TW	WIRING CIRCUIT
			GBU 14710 MOD A 14711 MOD A