

57 32 5- J

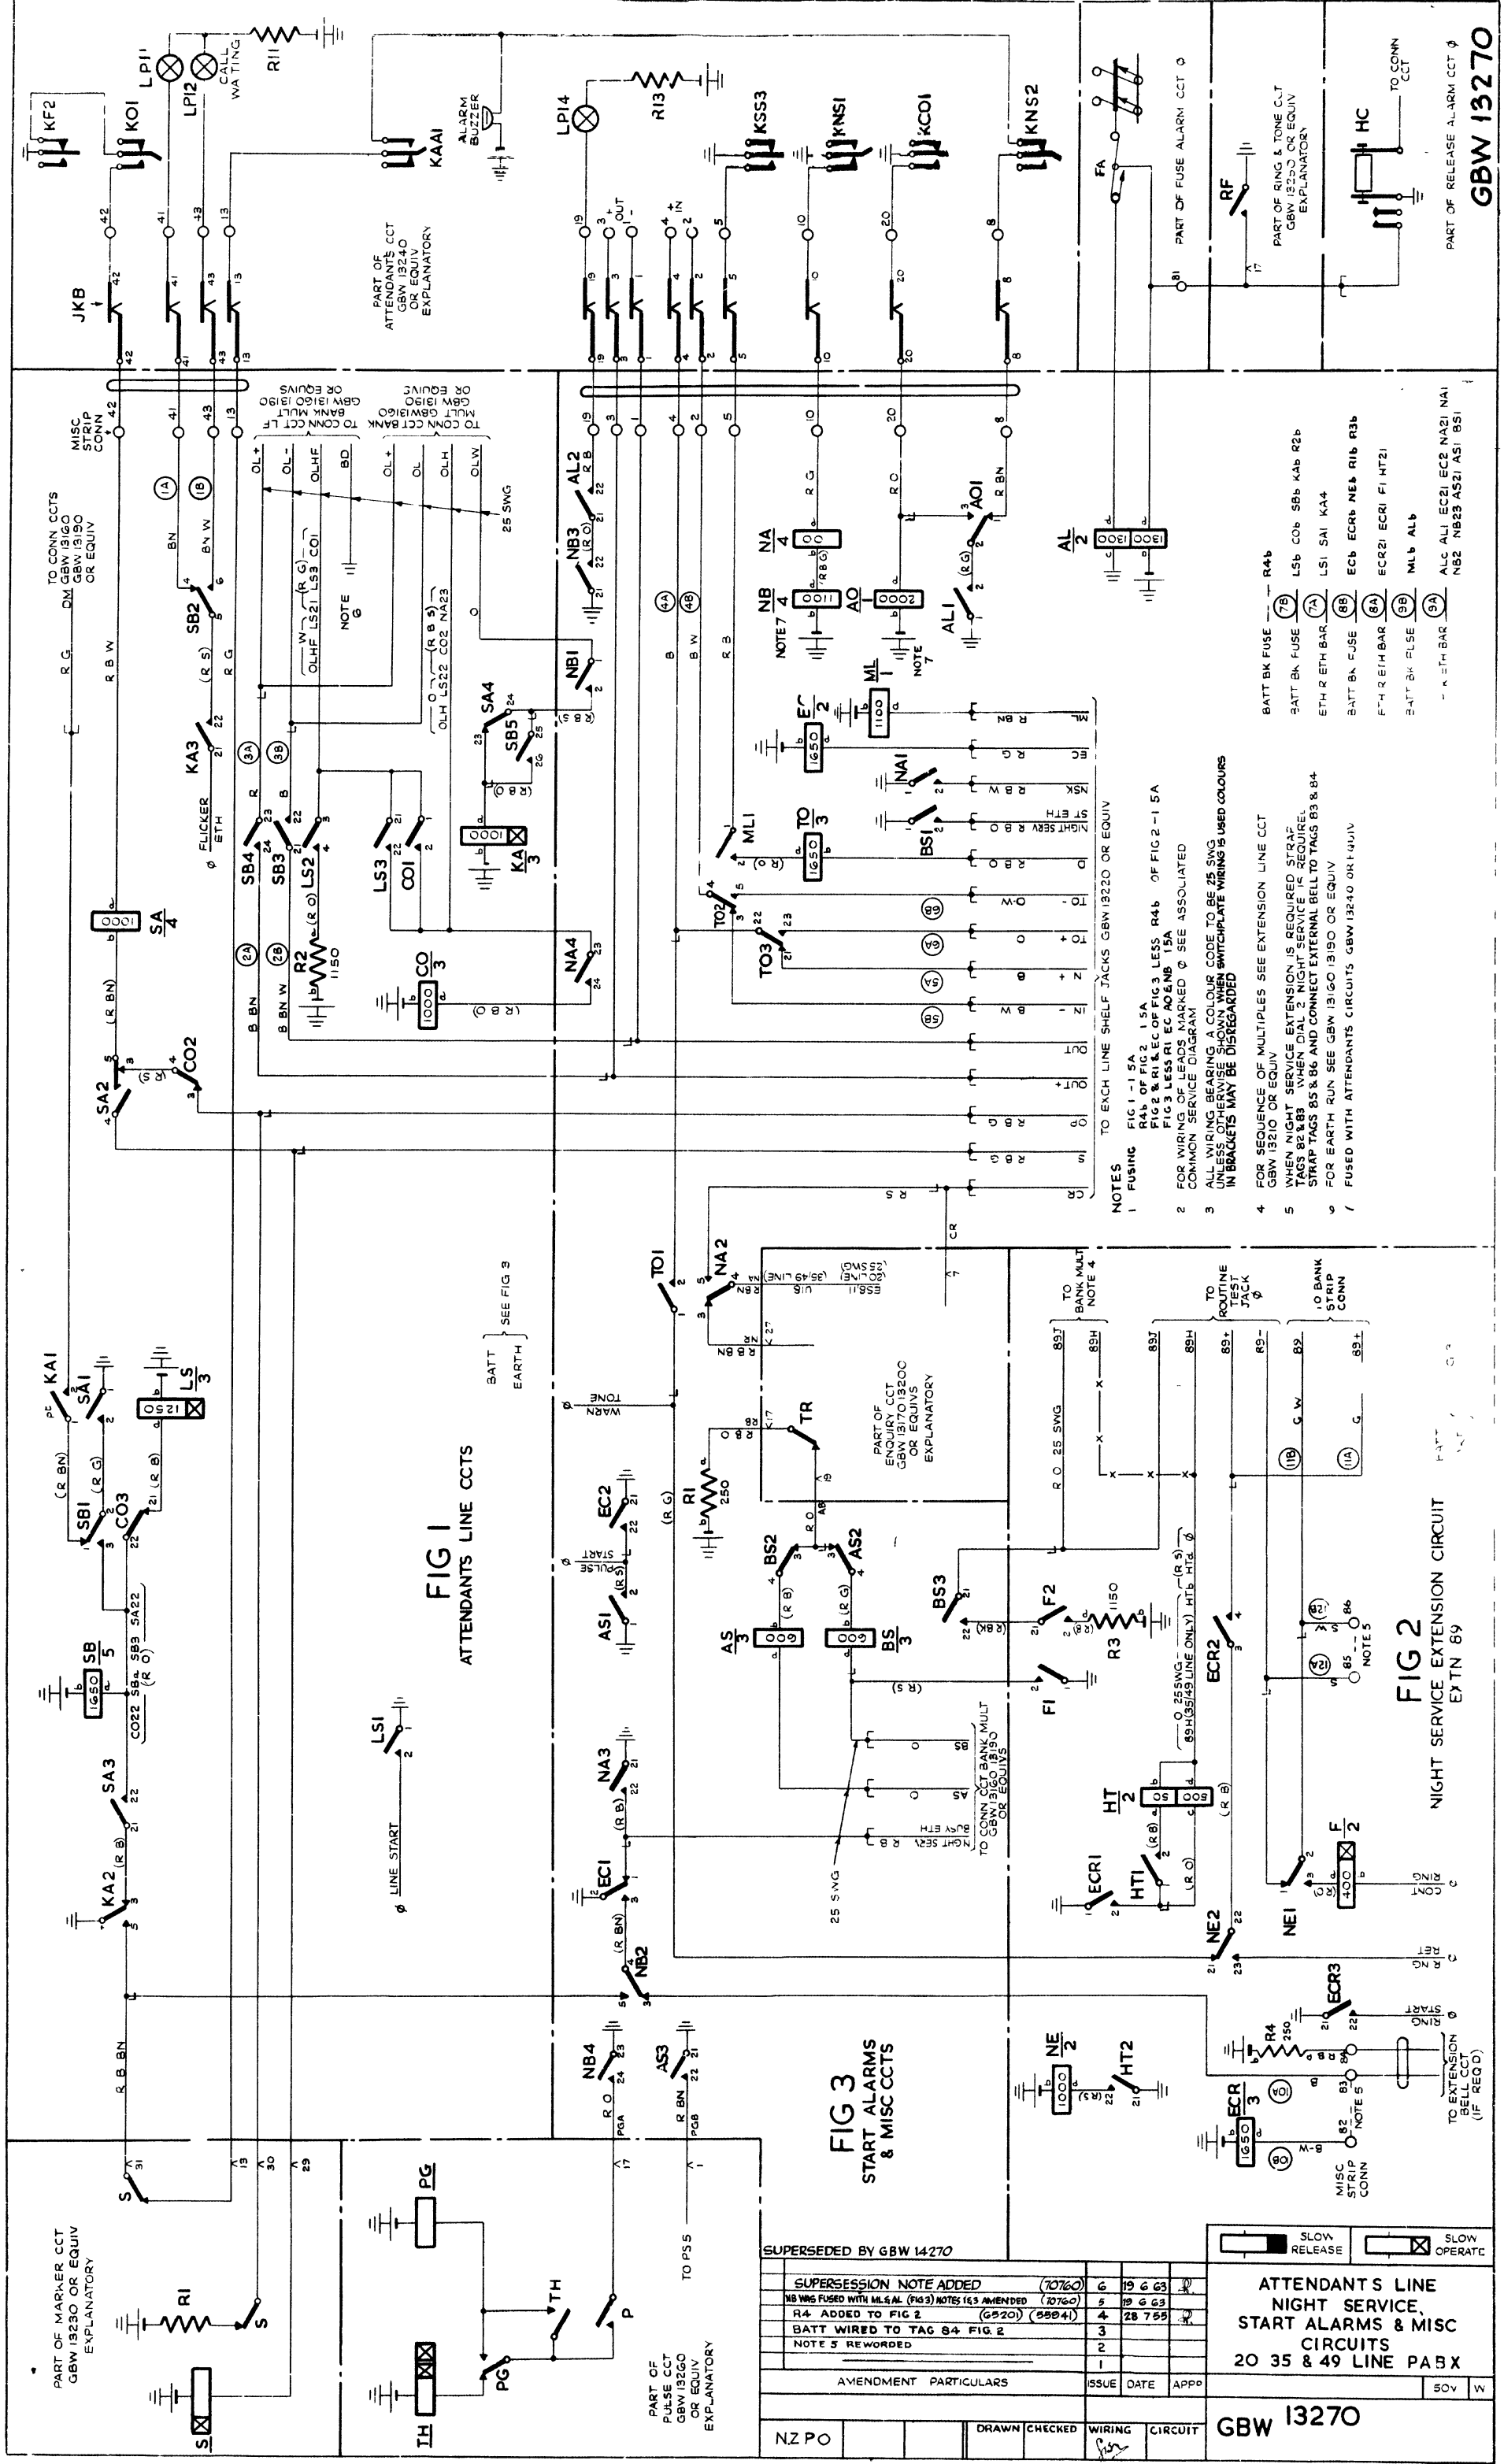


FIG 1 ATTENDANTS LINE CCTS

FIG 2 NIGHT SERVICE EXTENSION CIRCUIT

FIG 3 START ALARMS & MISC CCTS

NOTES
 1 PUSHER TO EACH LINE SHELF JACKS GBW 13220 OR EQUIV
 2 FIG 1-1 SA
 3 FIG 2 & RI & EC OF FIG 3 LESS R46 OF FIG 2-1 SA
 4 FOR WIRING OF LEADS MARKED ϕ SEE ASSOCIATED COMMON SERVICE DIAGRAM
 5 ALL WIRING BEARING A COLOUR CODE TO BE 25 SWG UNLESS OTHERWISE SHOWN WHEN SWITCHPLATE WIRING IS USED COLOURS IN BRACKETS MAY BE DISREGARDED
 6 FOR SEQUENCE OF MULTIPLES SEE EXTENSION LINE CCT GBW 13210 OR EQUIV
 7 WHEN NIGHT SERVICE EXTENSION IS REQUIRED STRAP TAGS 82 & 83 WHEN DIAL 2 NIGHT SERVICE IS REQUIRED STRAP TAGS 85 & 86 AND CONNECT EXTERNAL BELL TO TAGS 83 & 84 FOR EARTH RUN SEE GBW 13160 (3190) OR EQUIV
 8 FUSED WITH ATTENDANTS CIRCUITS GBW 13240 (4174) JUV

SUPERSEDED BY GBW 14270

SUPERSESSION NOTE ADDED		(70760)	6	19 6 63
NB WNG FUSED WITH M.L.S.M. (FIG 2) NOTES (1,5) AMENDED		(27760)	5	19 6 63
R4 ADDED TO FIG 2		(9520)	4	28 7 59
BATT WIRED TO TAG 84 FIG 2			3	
NOTE 5 REWORDED			1	
AMENDMENT PARTICULARS		ISSUE	DATE	APPP
NZ PO	DRAWN	CHECKED	WIRING	CIRCUIT

ATTENDANT'S LINE NIGHT SERVICE, START ALARMS & MISC CIRCUITS 20 35 & 49 LINE PABX	
50V	W

GBW 13270

GBW 13270