FIG 1

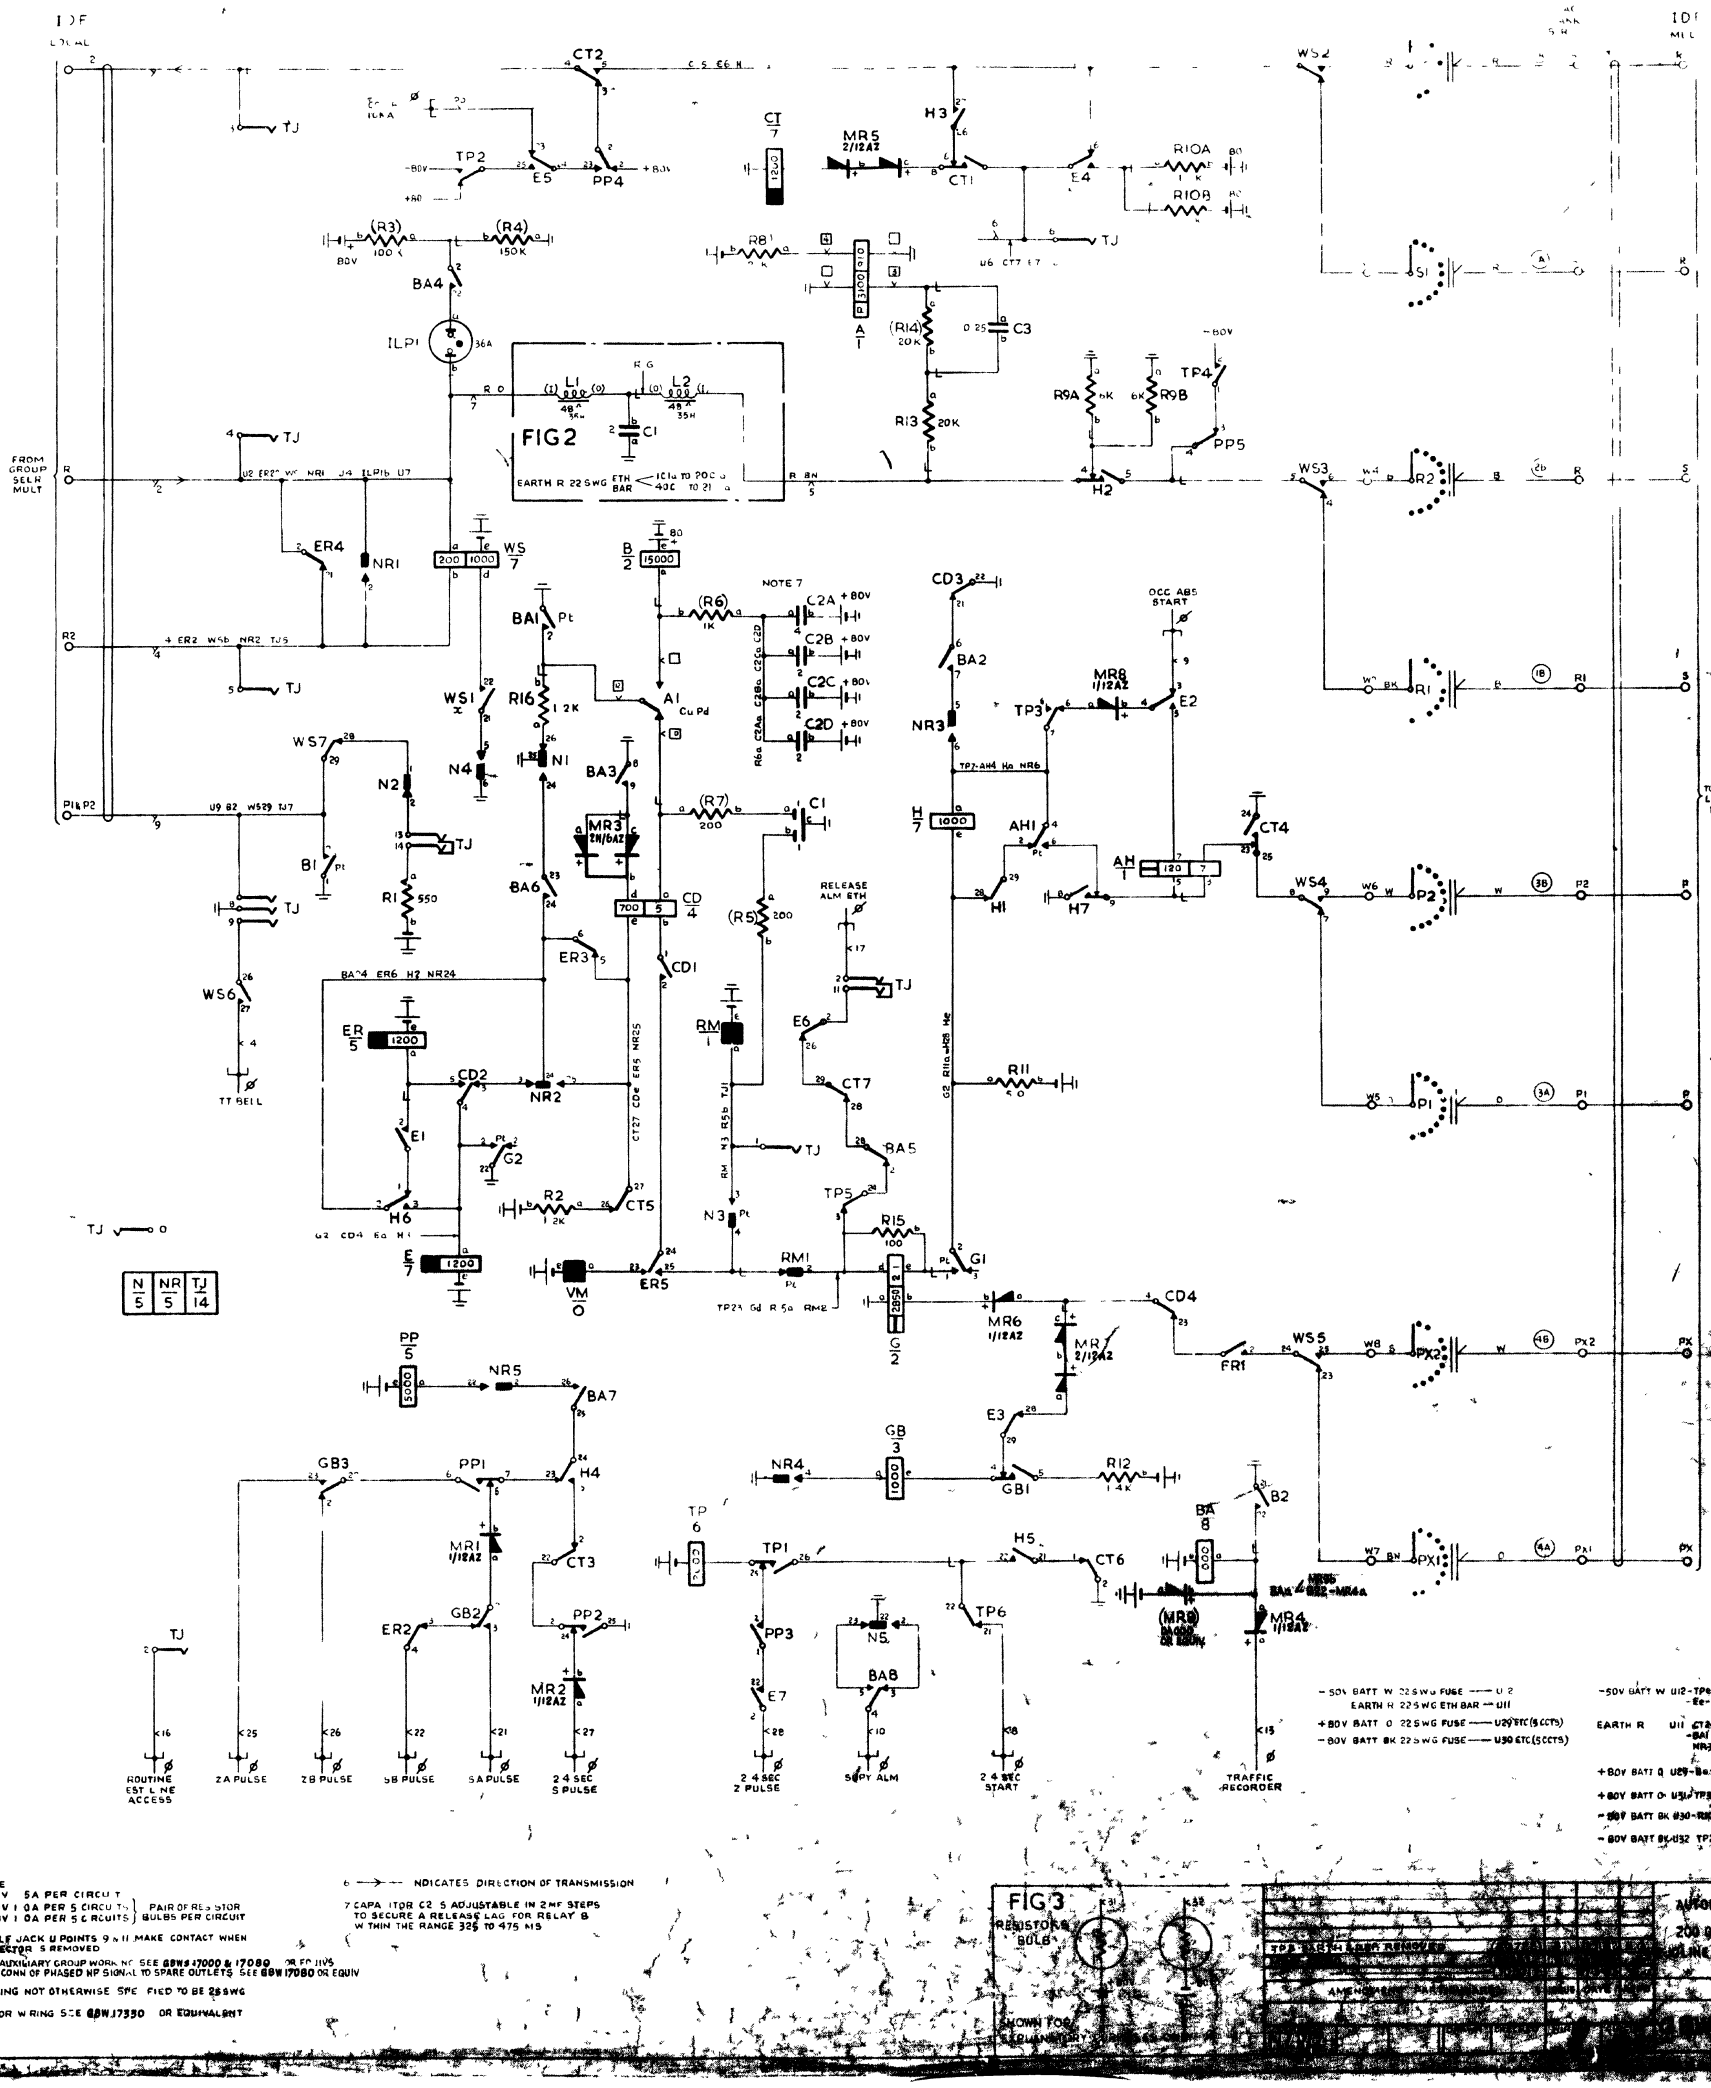

NOTES

1 FUSE
- 50V 5A PER CIRCUIT
- 80V 1 0A PER 5 CIRCUITS
+80V 1 0A PER 5 CIRCUITS
} PAIR OF RESISTOR BULBS PER CIRCUIT

2 SHELF JACK U POINTS 9 & 11 MAKE CONTACT WHEN SELECTOR IS REMOVED

3 FOR AUXILIARY GROUP WORKING SEE GBW 17000 & 17080 OR EQUIVS
FOR CONN OF PHASED NP SIGNAL TO SPARE OUTLETS SEE GBW 17080 OR EQUIV

4 WIRING NOT OTHERWISE SPECIFIED TO BE 22 SWG

5 ⌀ FOR WIRING SEE GBW 17350 OR EQUIVALENT

6 ——→—— INDICATES DIRECTION OF TRANSMISSION

7 CAPACITOR C2 5 ADJUSTABLE IN 2MF STEPS TO SECURE A RELEASE LAG FOR RELAY B WITHIN THE RANGE 325 TO 475 MS

FIG 3
RESISTOR BULB
SHOWN FOR EQUIPMENT